


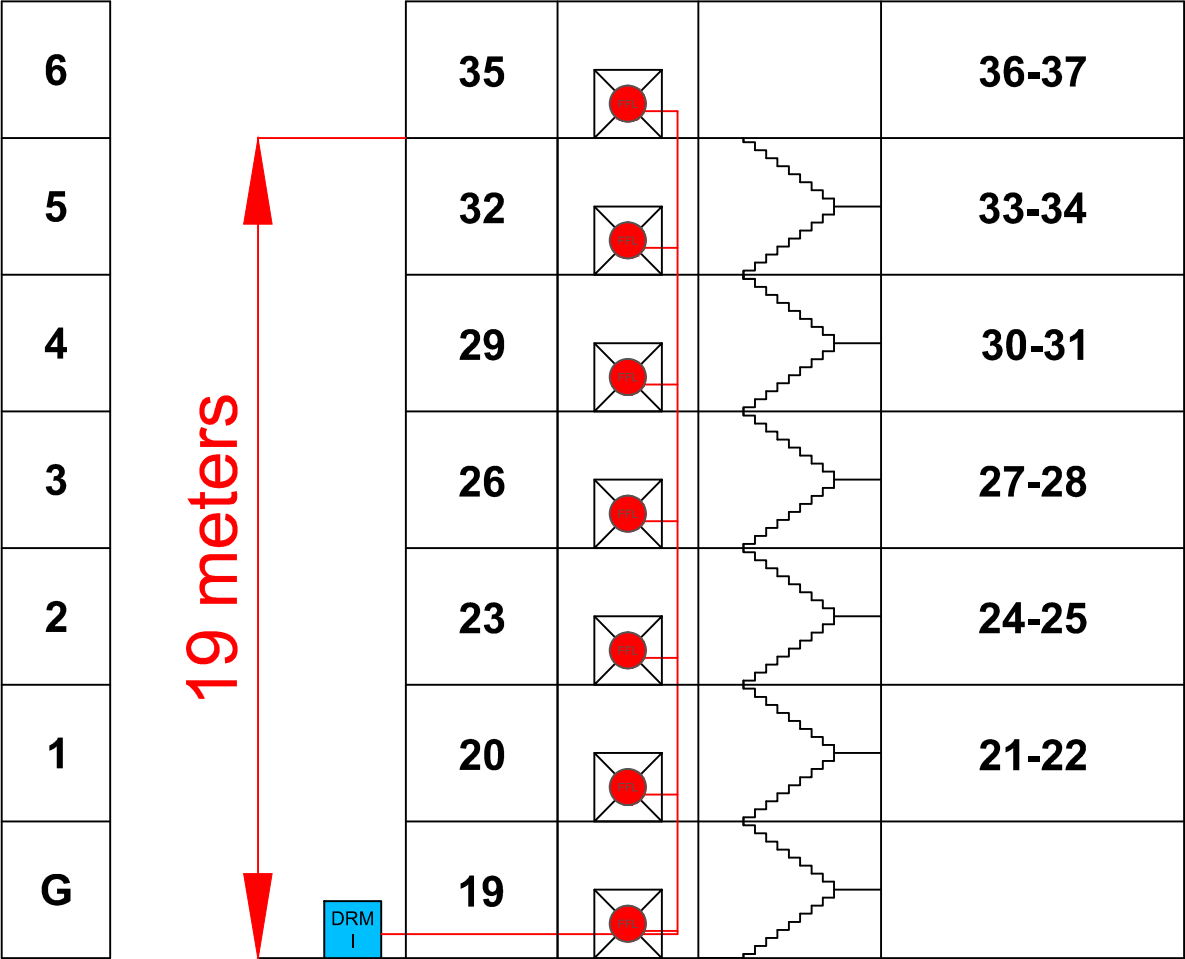

NOTE:

MEASUREMENTS ARE APPROXIMATE

KEY:

PASSENGER LIFT WITH
OVERRIDE CONTROL

DRY RISER INLET

DRY RISER SCHEMATIC



DRAWING No.	APPROVED BY
002	
DRAWN BY	CHECKED BY
AB	M.P

DESCRIPTION
VERTICAL SECTION SCHEMATIC
SITE ADDRESS
19-37, FIRECREST RIDDING, UB6 0FB

JOB NUMBER		DATE
N/A		21/9/23
SCALE	UNIT	REVISION
N.T.S	mm	INFORMATION ONLY