


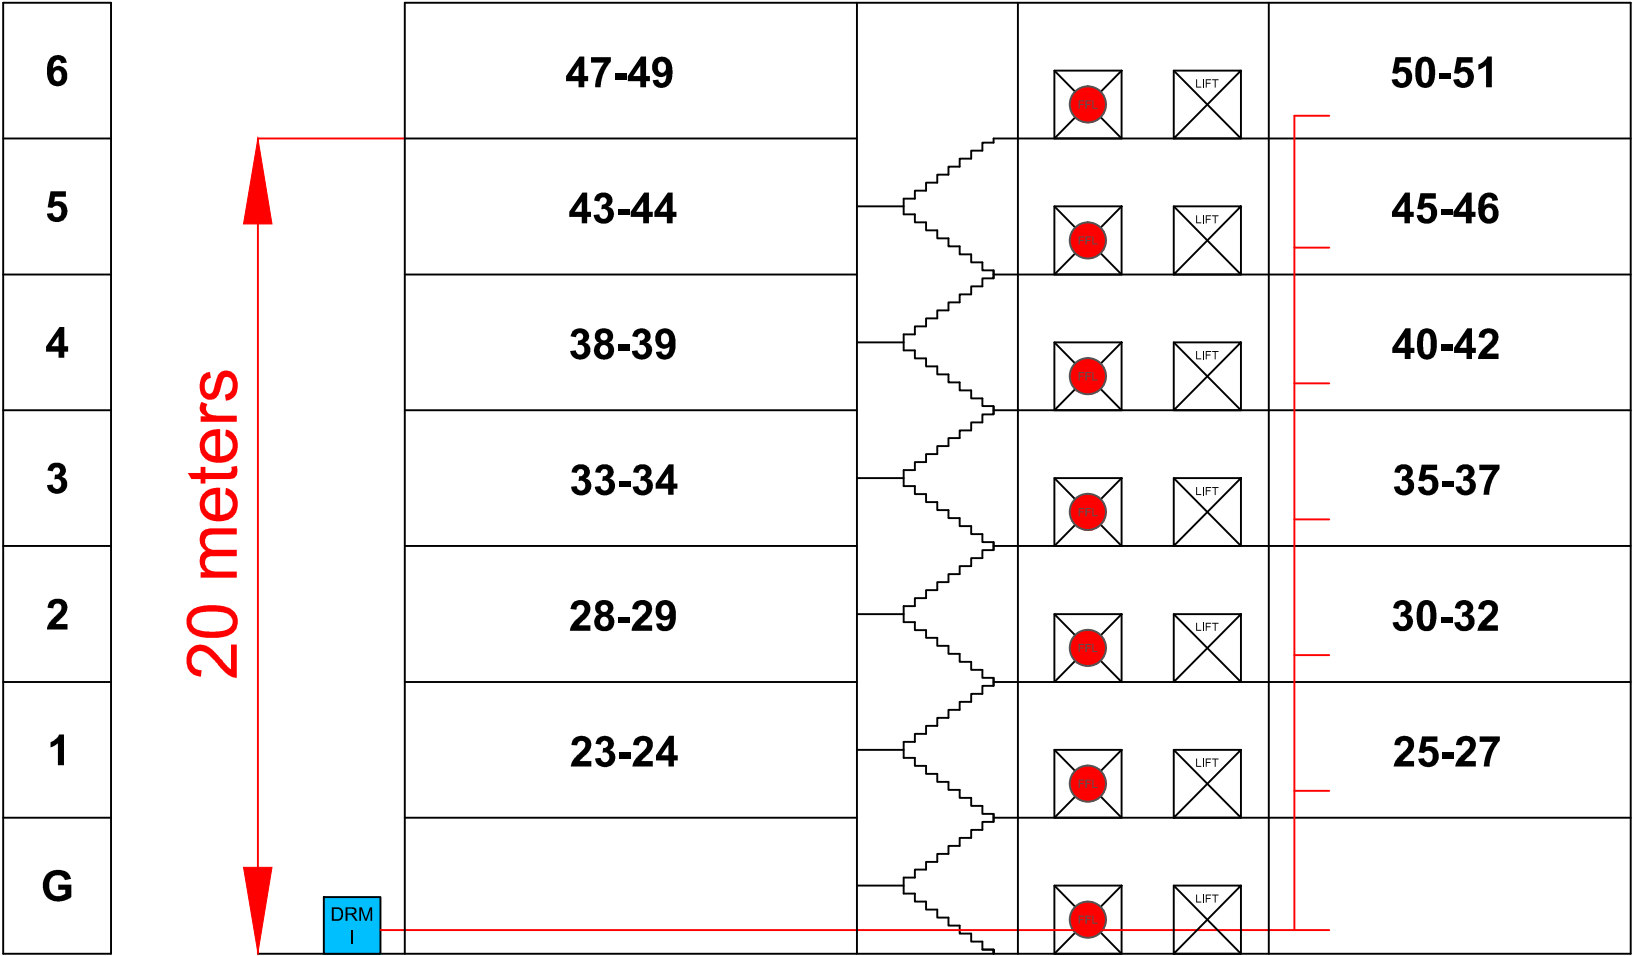

NOTE:
MEASUREMENTS ARE APPROXIMATE

KEY:

FIRE FIGHTING LIFT

DRM I

DRY RISER INLET

F

DRY RISER SCHEMATIC



DRAWING No.	APPROVED BY	DESCRIPTION
002		VERTICAL SECTION SCHEMATIC
DRAWN BY	CHECKED BY	SITE ADDRESS
N.B	M.P	23-51 HORNBEAM APARTMENTS, SEVEN SISTERS ROAD, N4 1JU

JOB NUMBER		DATE
N/A		18/8/23
SCALE	UNIT	REVISION
N.T.S	mm	INFORMATION ONLY