


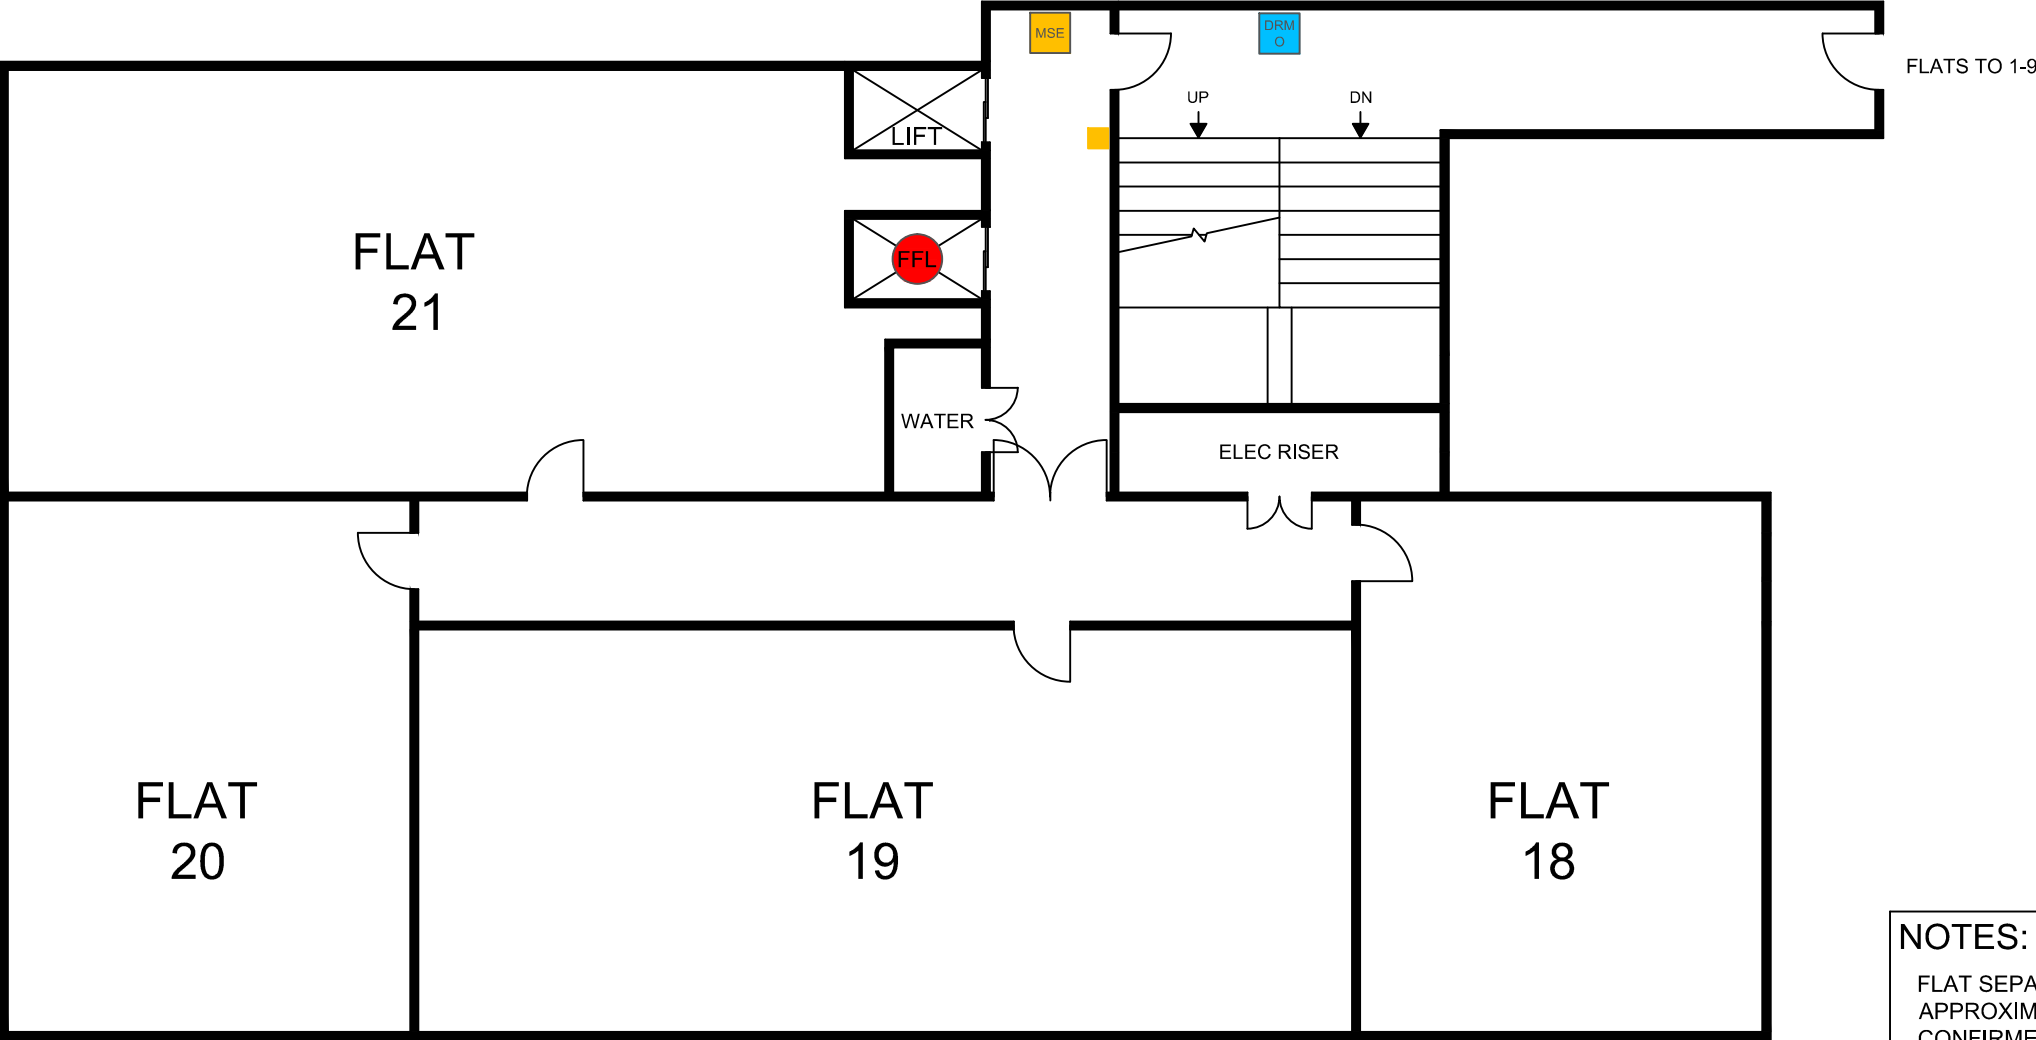

NOTES:

FLAT SEPARATION WALLS ARE APPROXIMATE AND TO BE CONFIRMED

THIS DRAWING IS INTENDED FOR INCLUSION WITHIN THE PIB/ERP ONLY. DUE TO LACK OF SCALING AND INDICATIVE NATURE THIS DRAWING SHOULD NOT BE ISSUED FOR DESIGN OR CONSTRUCTION PURPOSE

- KEY:**
-  SMOKE VENT SWITCH
 -  MECHANICAL SMOKE EXTRACTION
 -  FIREFIGHTING LIFT
 -  DRY RISER OUTLET

	DRAWING No.	APPROVED BY	FOURTH FLOOR LAYOUT			JOB NUMBER		DATE	
	010					N/A		20/03/24	
	DRAWN BY	CHECKED BY	SITE ADDRESS			SCALE	UNIT	REVISION	
	N.B.L	MP				N.T.S	mm	INFORMATION ONLY	

Flats 10-37, Samuel Building, 38 Shackleton Way, London, E16 2JT