


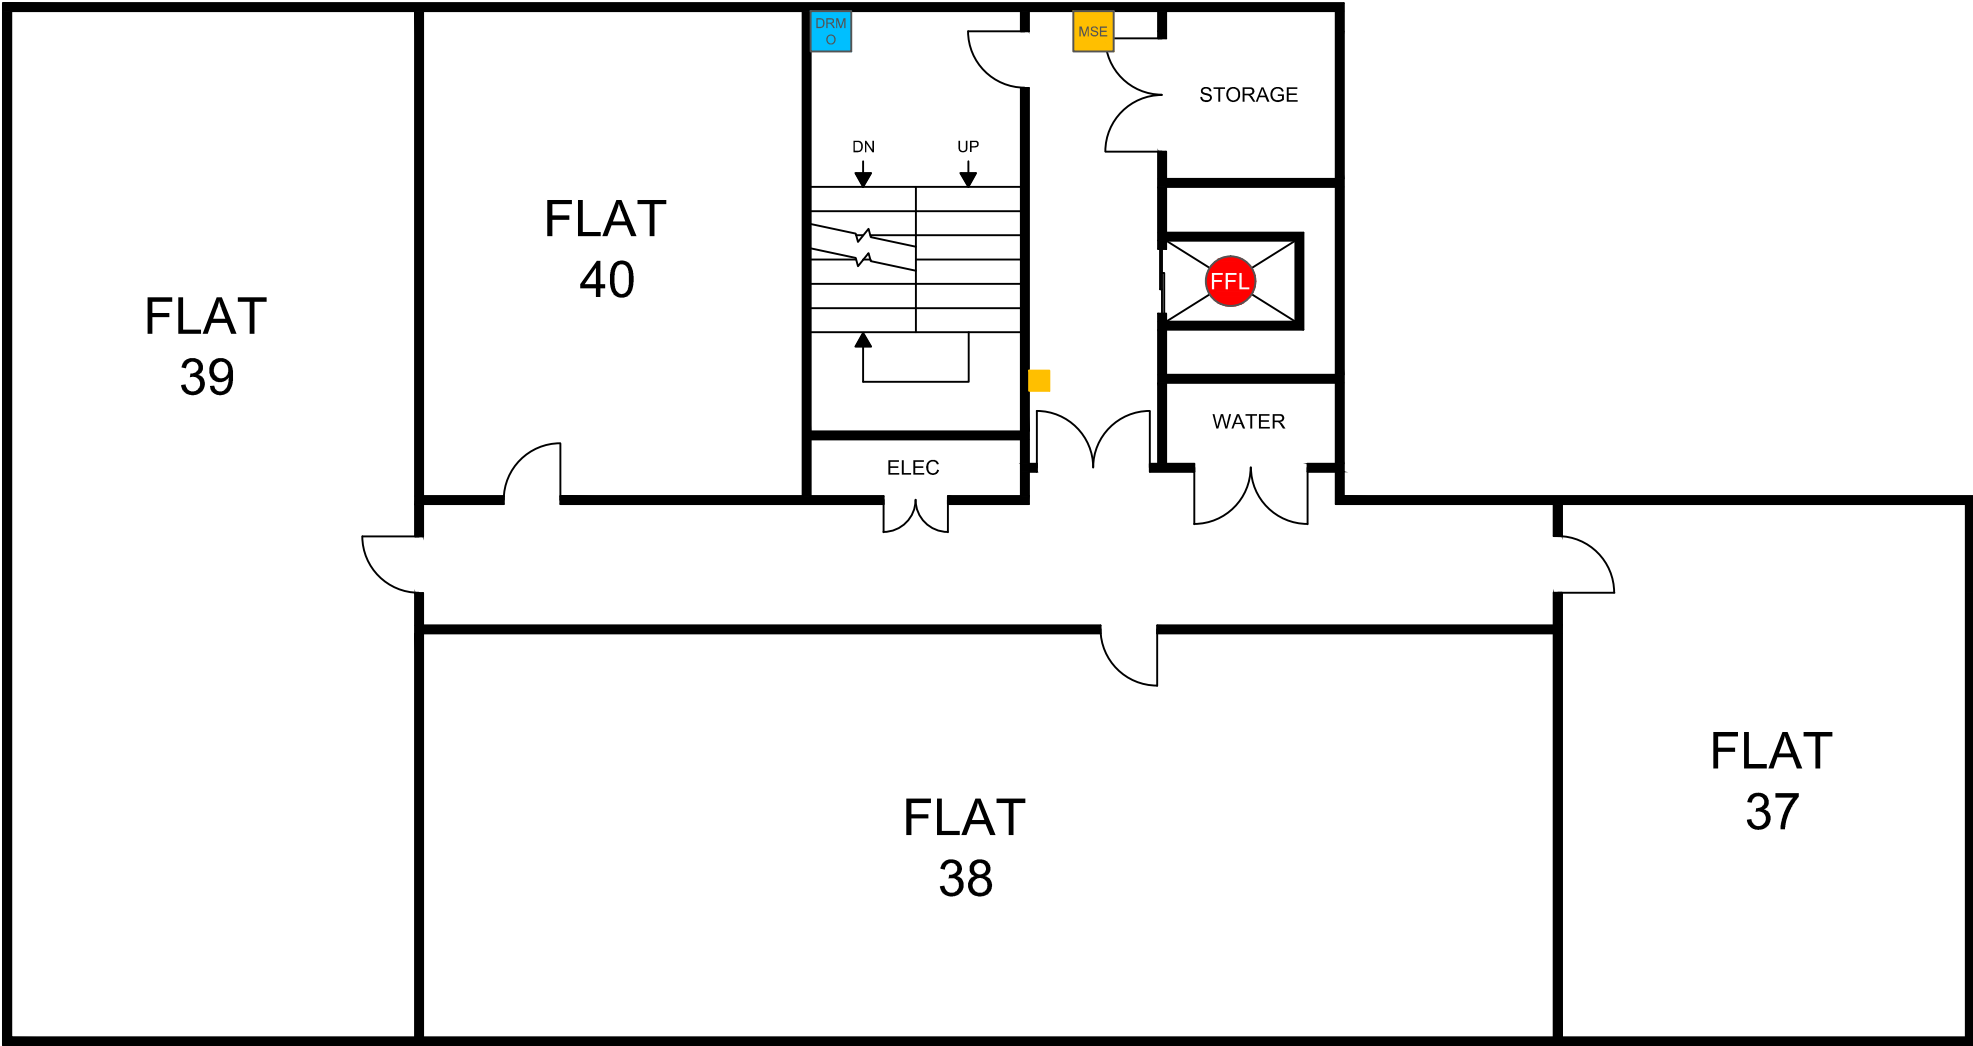

NOTES:

FLAT SEPARATION WALLS ARE APPROXIMATE AND TO BE CONFIRMED

THIS DRAWING IS INTENDED FOR INCLUSION WITHIN THE PIB/ERP ONLY. DUE TO LACK OF SCALING AND INDICATIVE NATURE THIS DRAWING SHOULD NOT BE ISSUED FOR DESIGN OR CONSTRUCTION PURPOSE

KEY:

-  SMOKE VENT SWITCH
-  MECHANICAL SMOKE EXTRACTION
-  FIREFIGHTING LIFT
-  DRY RISER OUTLET

	DRAWING No.	APPROVED BY	DESCRIPTION			JOB NUMBER		DATE
	009		THIRD FLOOR LAYOUT			N/A		2/2/24
	DRAWN BY	CHECKED BY	SITE ADDRESS			SCALE	UNIT	REVISION
	N.B.L	MP	BOYD BUILDING, 10 FROBISHER YARD, E16 2GY			N.T.S	mm	INFORMATION ONLY