


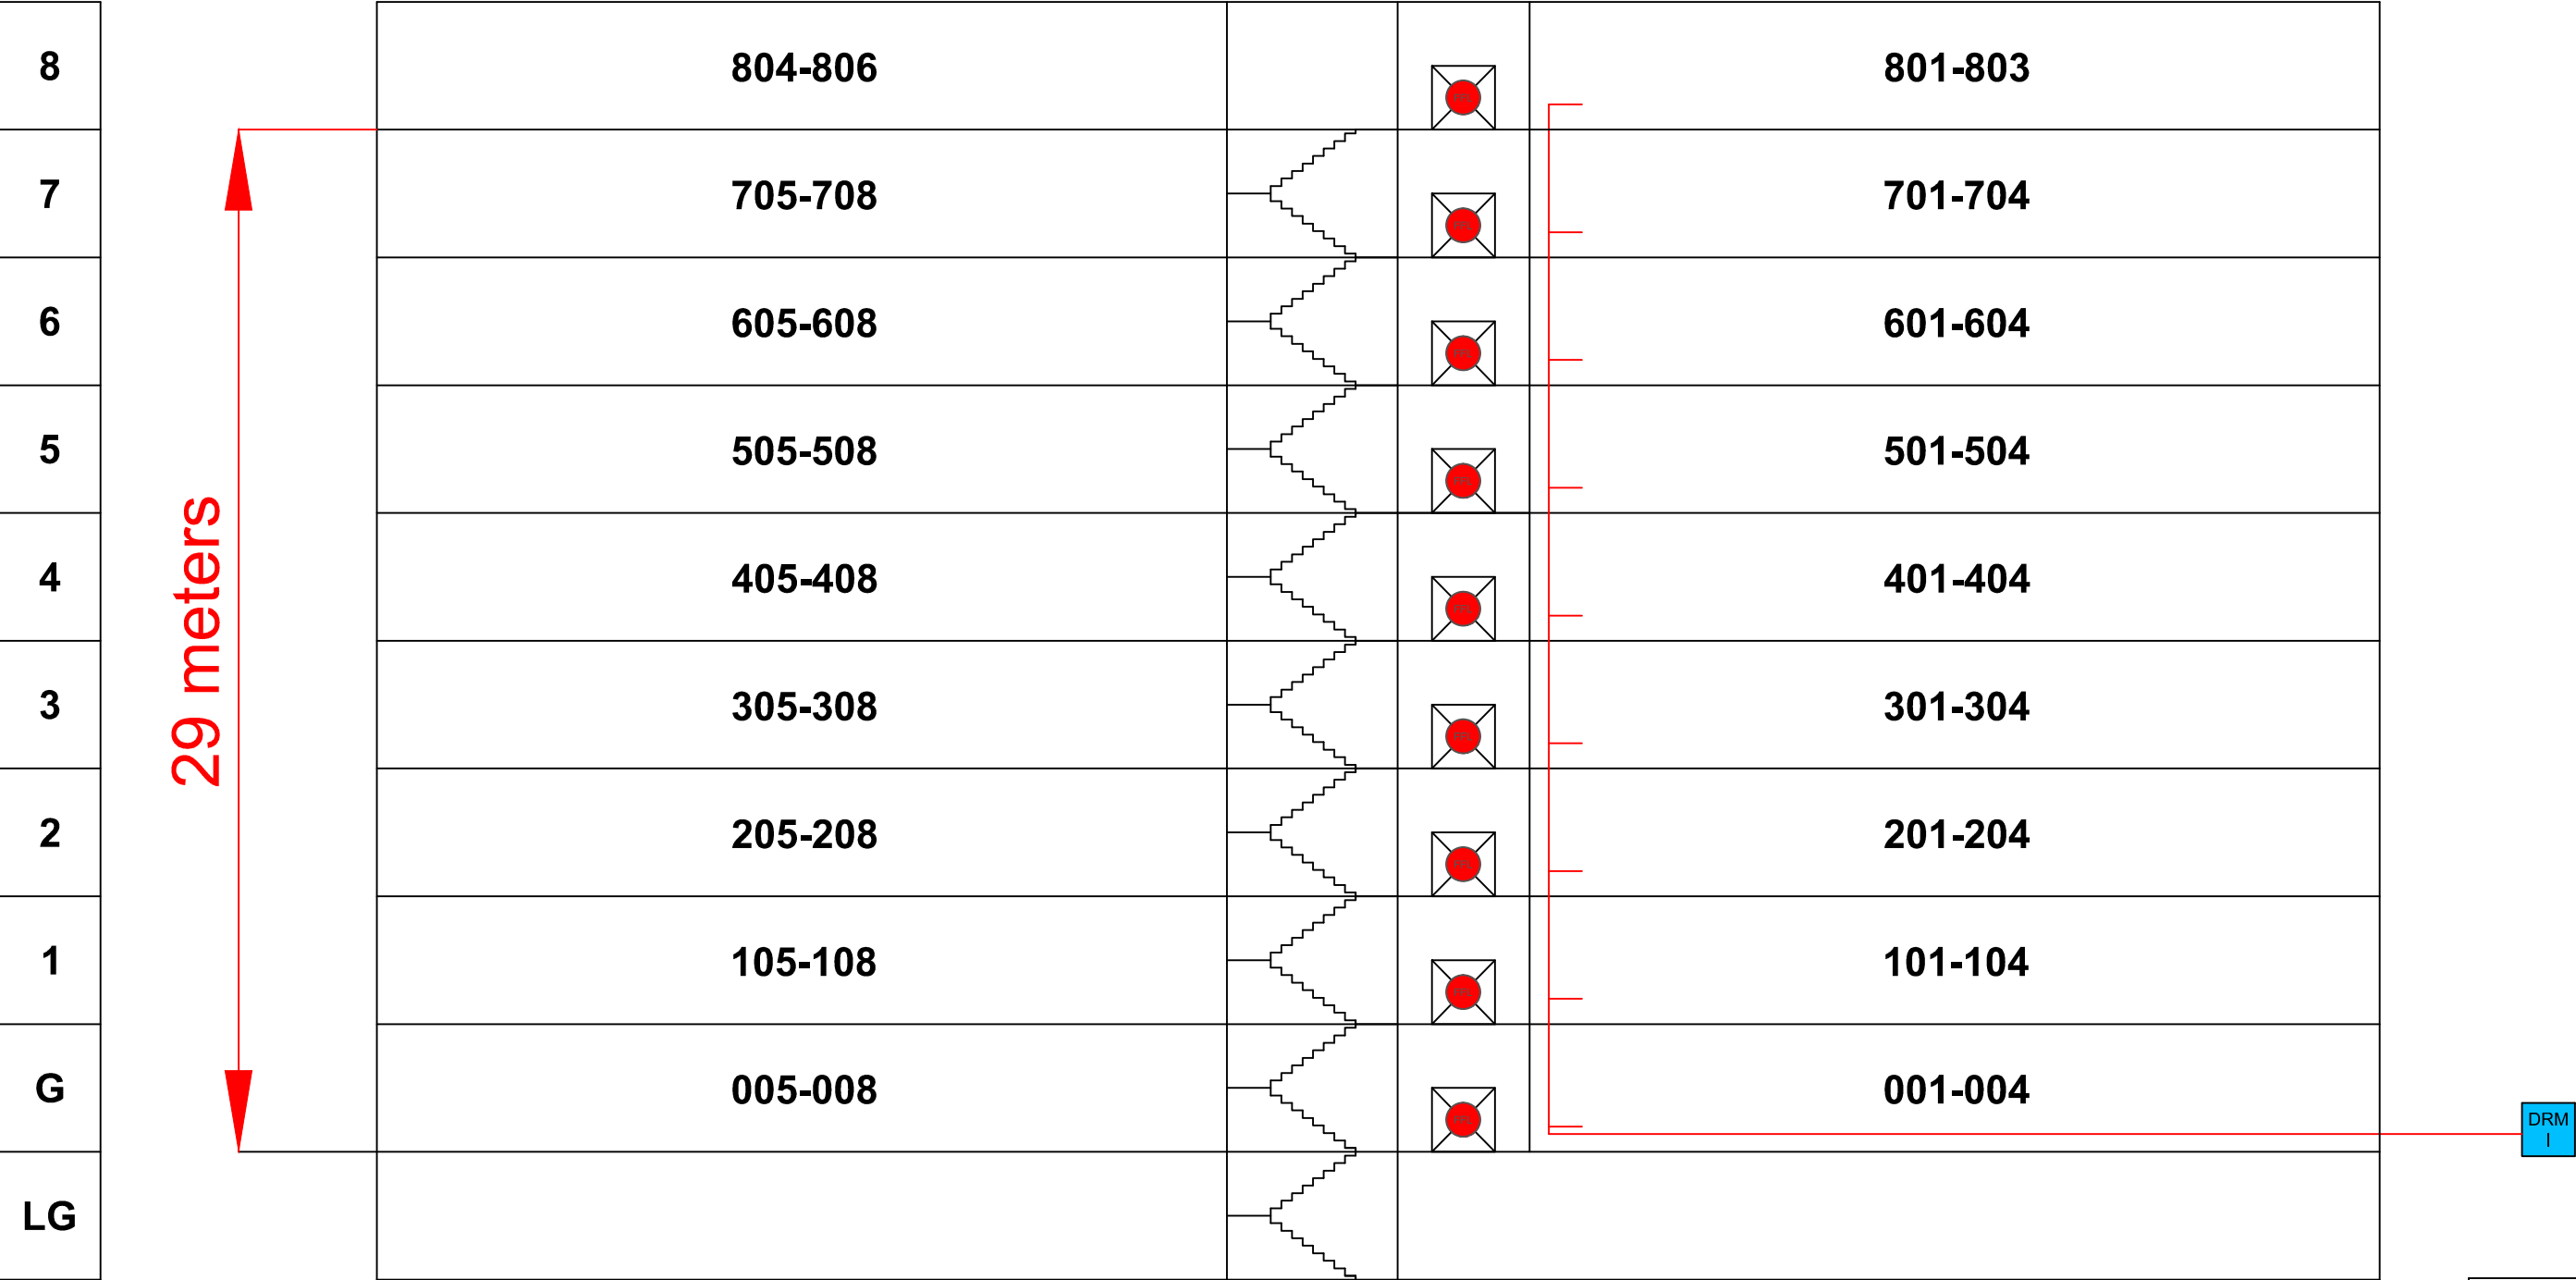

NOTE:

MEASUREMENTS ARE APPROXIMATE

KEY:

FIRE FIGHTING LIFT

DRM I

DRY RISER INLET

DRY RISER SCHEMATIC



DRAWING No.	APPROVED BY	DESCRIPTION	JOB NUMBER		DATE
002		VERTICAL SECTION SCHEMATIC	N/A		20/8/23
DRAWN BY	CHECKED BY		SCALE	UNIT	REVISION
N.B	M.P	001-806 Eclipse Court, 1 Barnard Square, IP2 8FD	N.T.S	mm	INFORMATION ONLY