


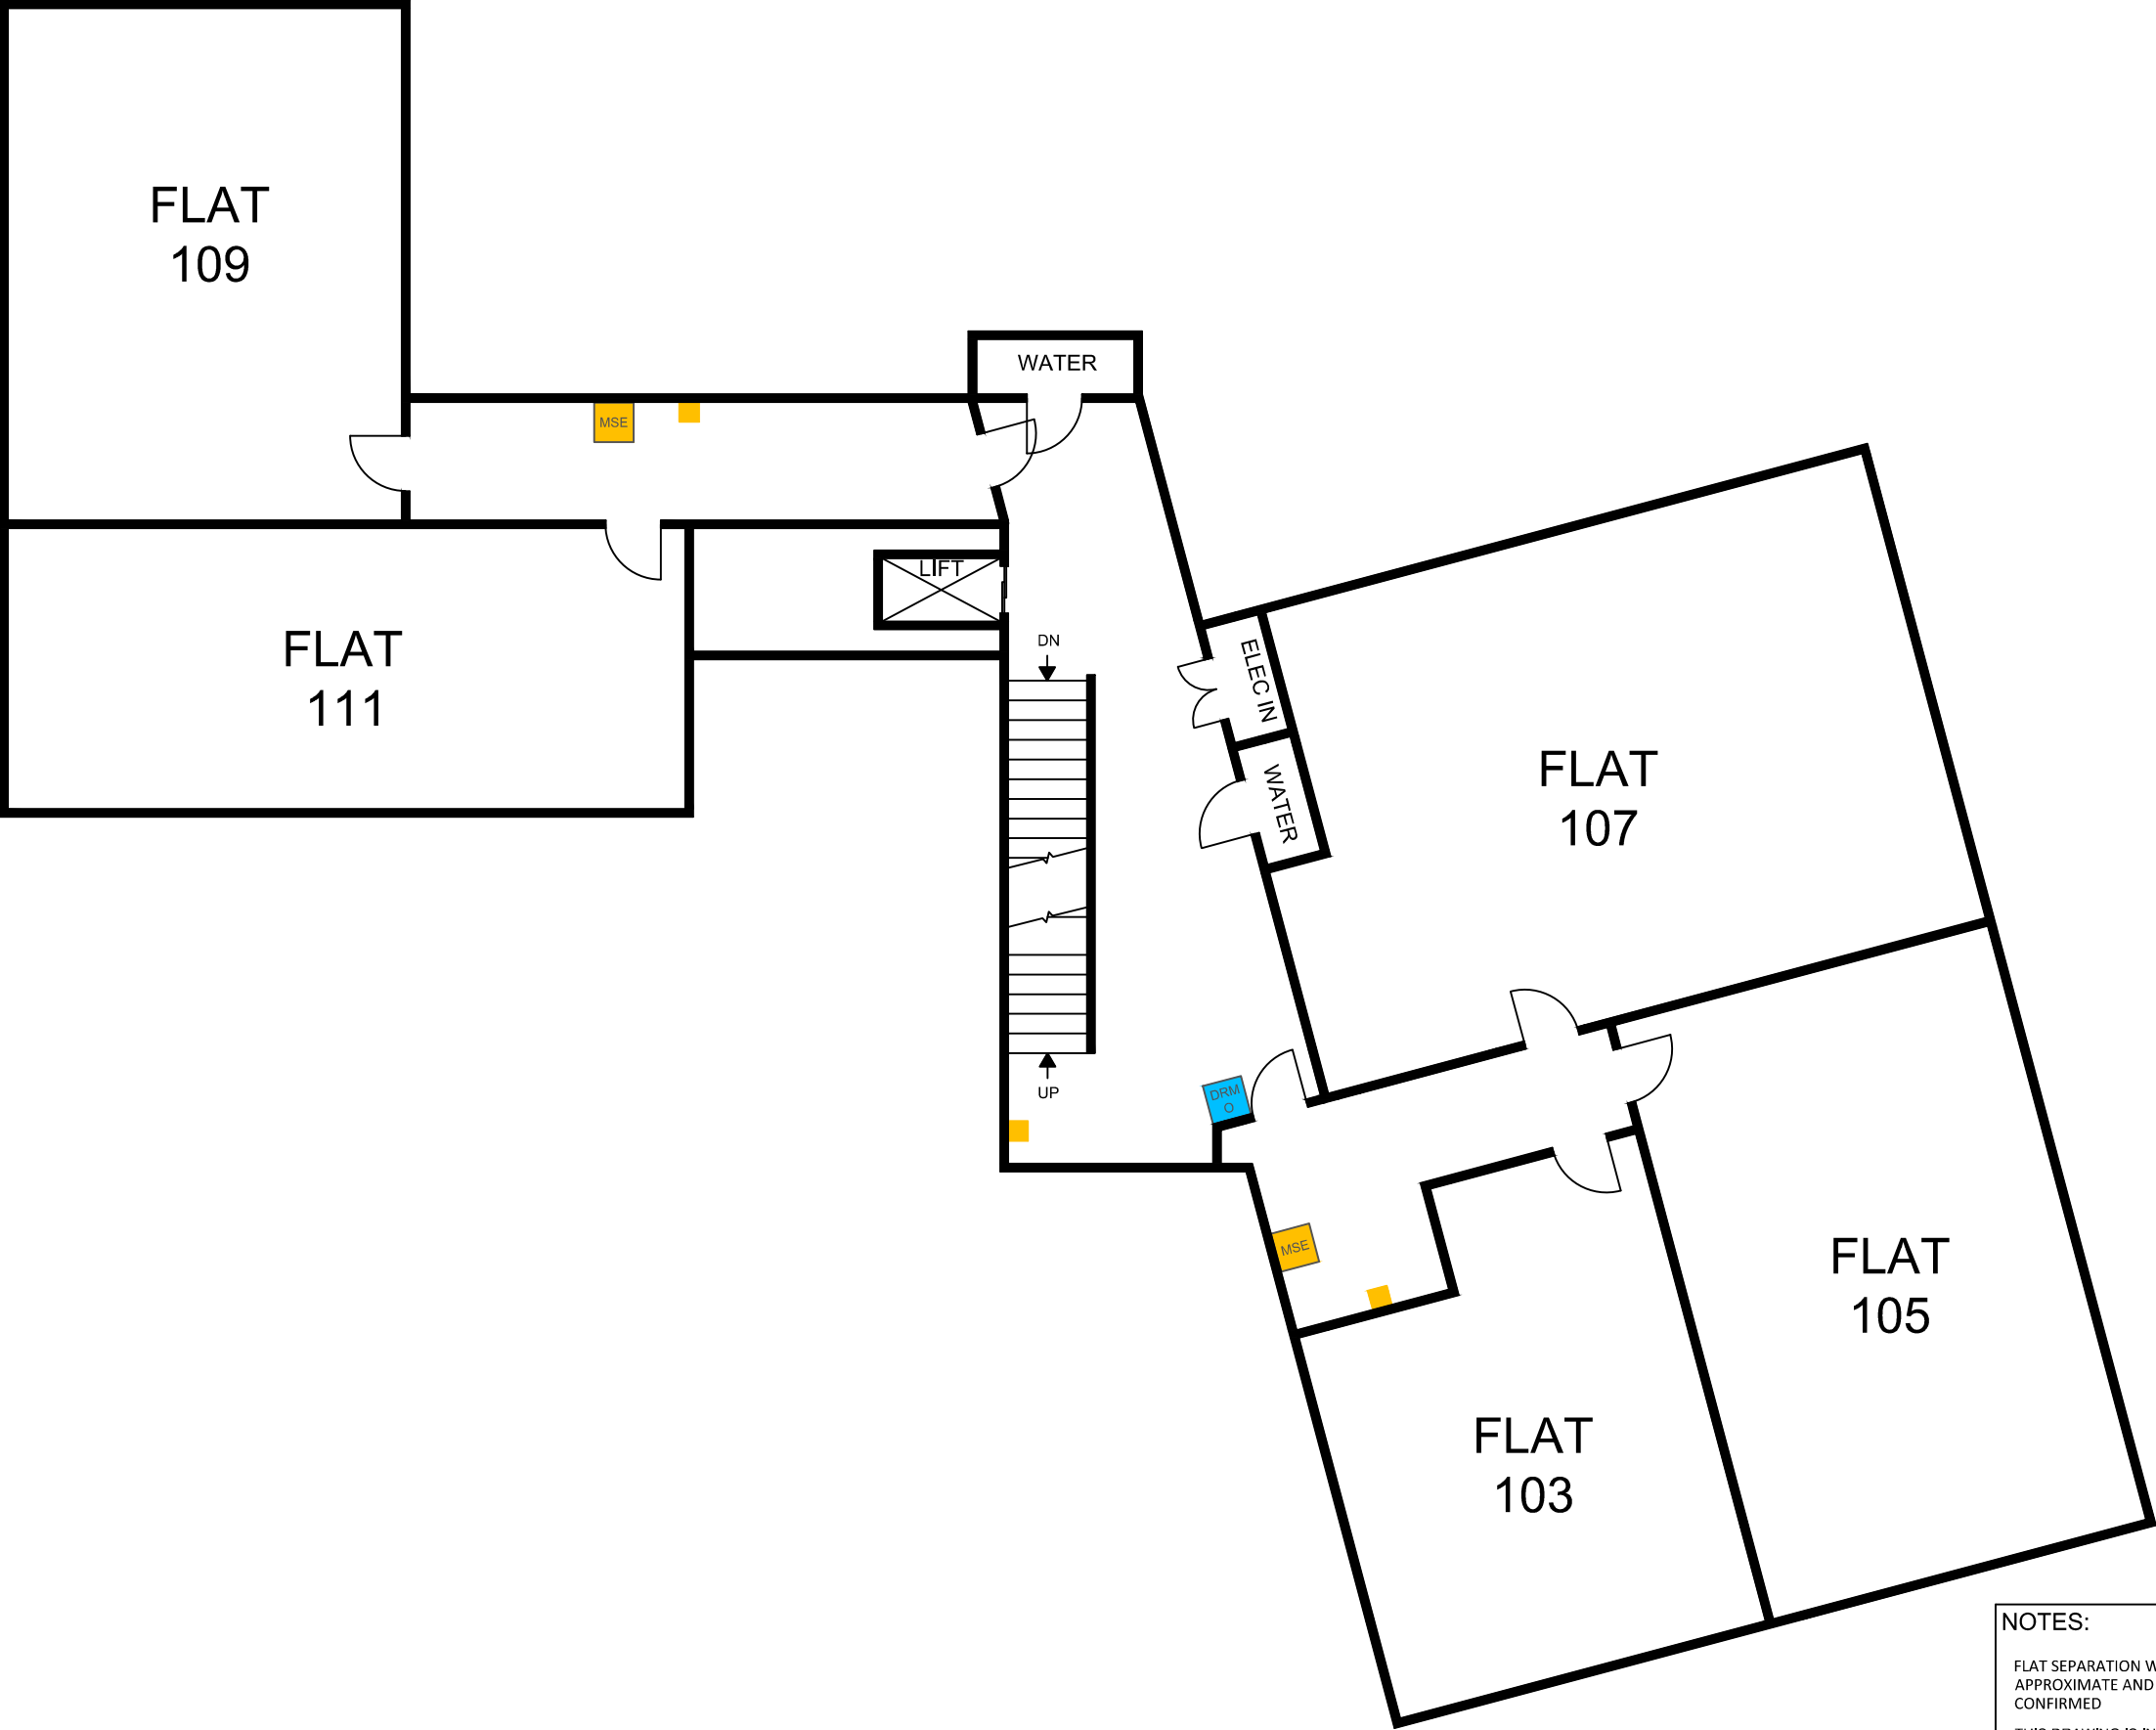

NOTES:

FLAT SEPARATION WALLS ARE APPROXIMATE AND TO BE CONFIRMED

THIS DRAWING IS INTENDED FOR INCLUSION WITHIN THE PIB/ERP ONLY. DUE TO LACK OF SCALING AND INDICATIVE NATURE THIS DRAWING SHOULD NOT BE ISSUED FOR DESIGN OR CONSTRUCTION PURPOSE

KEY:

-  SMOKE VENT SWITCH
-  MECHANICAL SMOKE EXTRACTION
-  DRY RISER OUTLET

	DRAWING No.	APPROVED BY	DESCRIPTION				JOB NUMBER		DATE
	008		THIRD FLOOR LAYOUT				N/A		13/02/24
	DRAWN BY	CHECKED BY	SITE ADDRESS				SCALE	UNIT	REVISION
	N.B.L	MP	75-135 Williams Way, Wembley, HA0 2FP				N.T.S	mm	INFORMATION ONLY