




NOTE:
MEASUREMENTS ARE APPROXIMATE

KEY:

- FIRE FIGHTING LIFT
- DRY RISER INLET
- DRY RISER SCHEMATIC

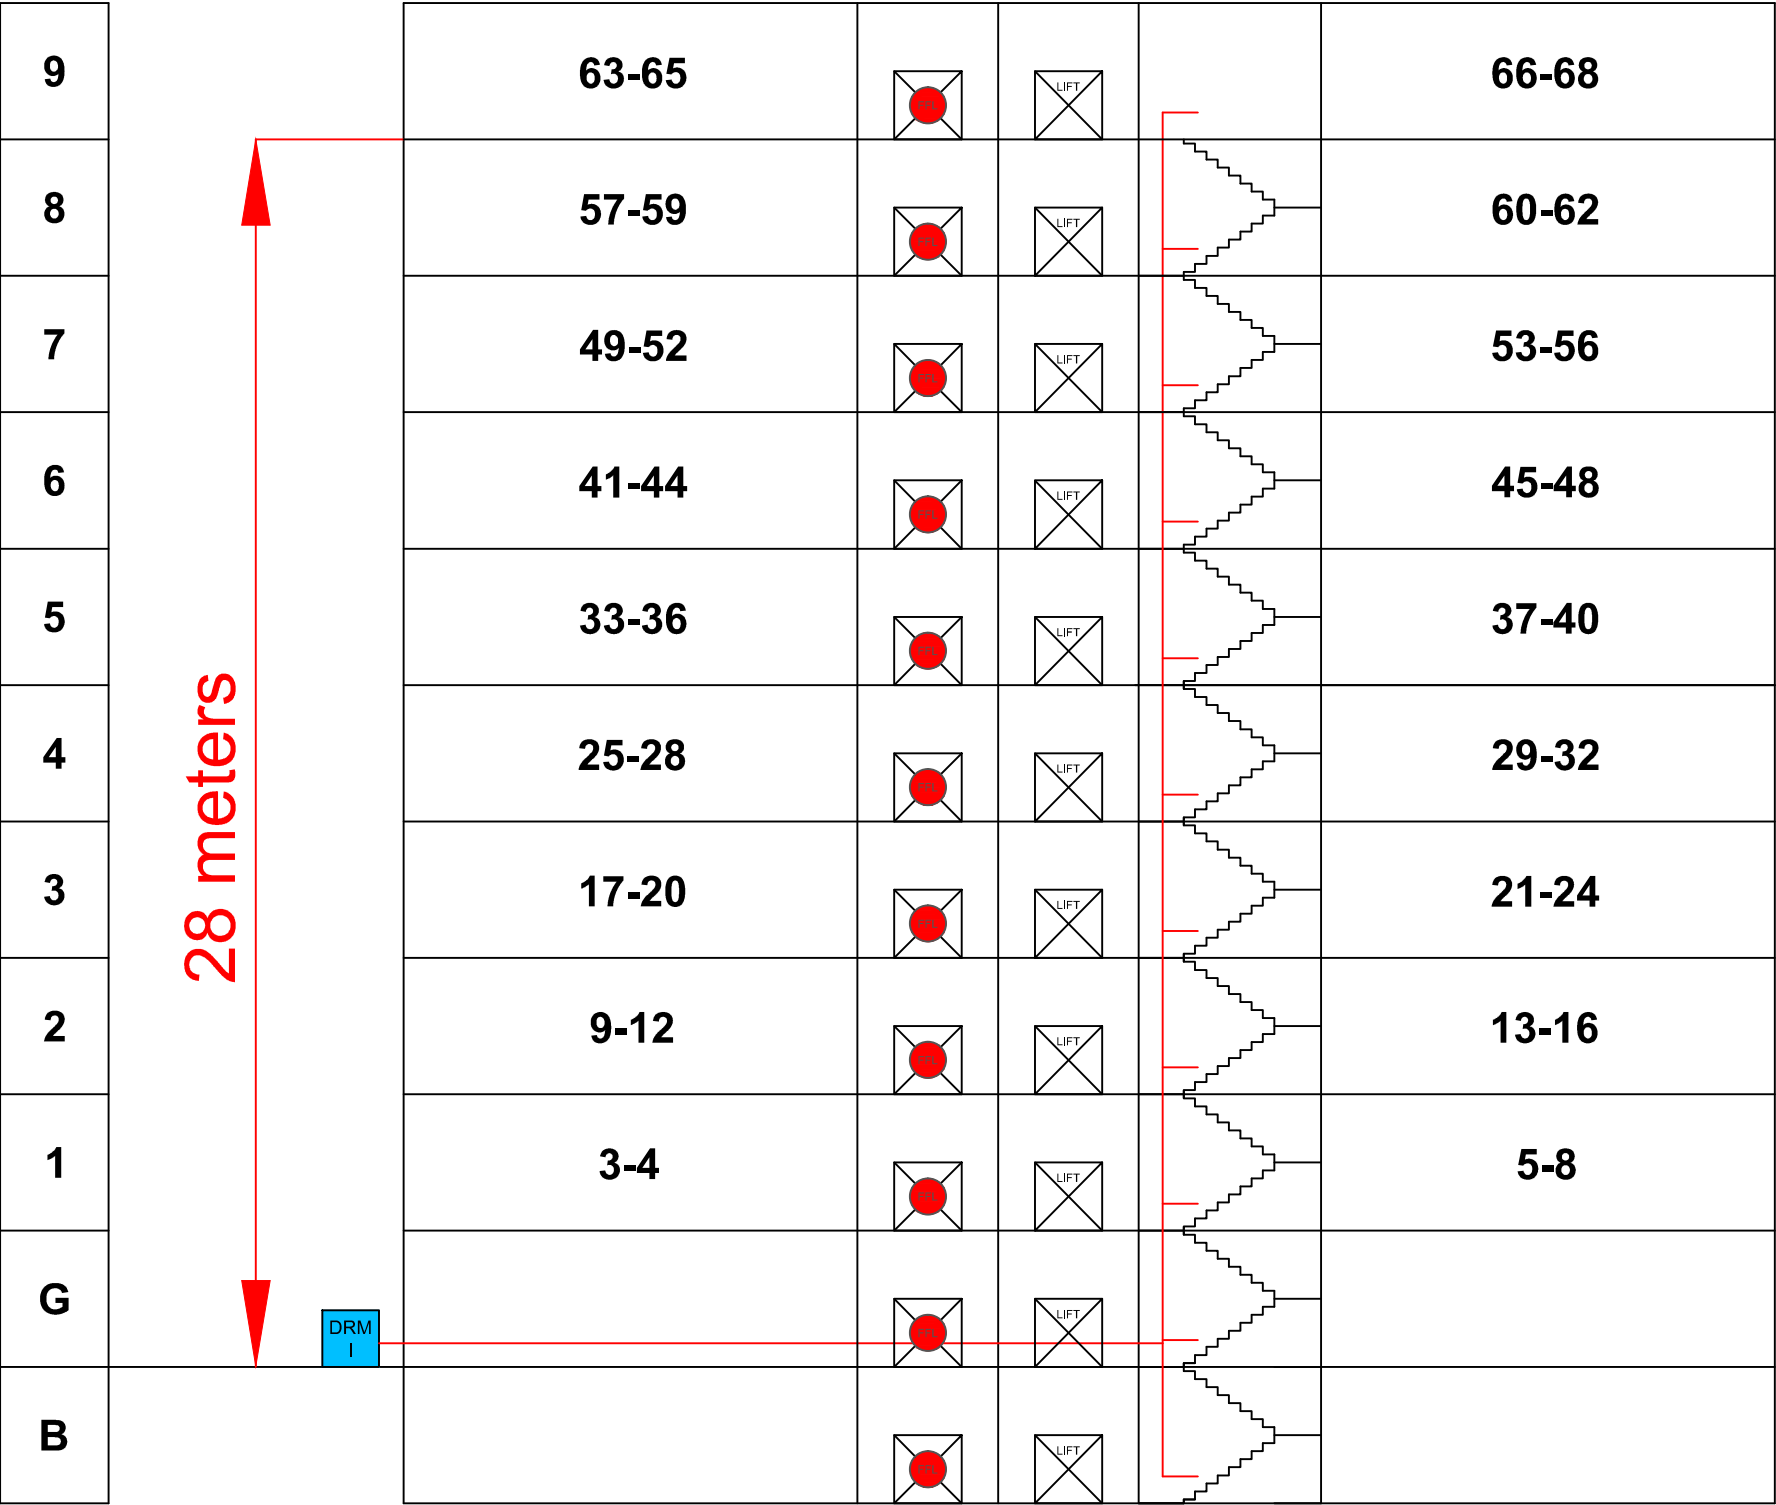

DRAWING No.	APPROVED BY	DESCRIPTION	JOB NUMBER		DATE
002			N/A		20/8/23
DRAWN BY	CHECKED BY	SITE ADDRESS	SCALE	UNIT	REVISION
N.B	M.P		N.T.S	mm	INFORMATION ONLY

VERTICAL SECTION SCHEMATIC

1-68 Ruby Court, 9 Warton Road, E15 2GD