


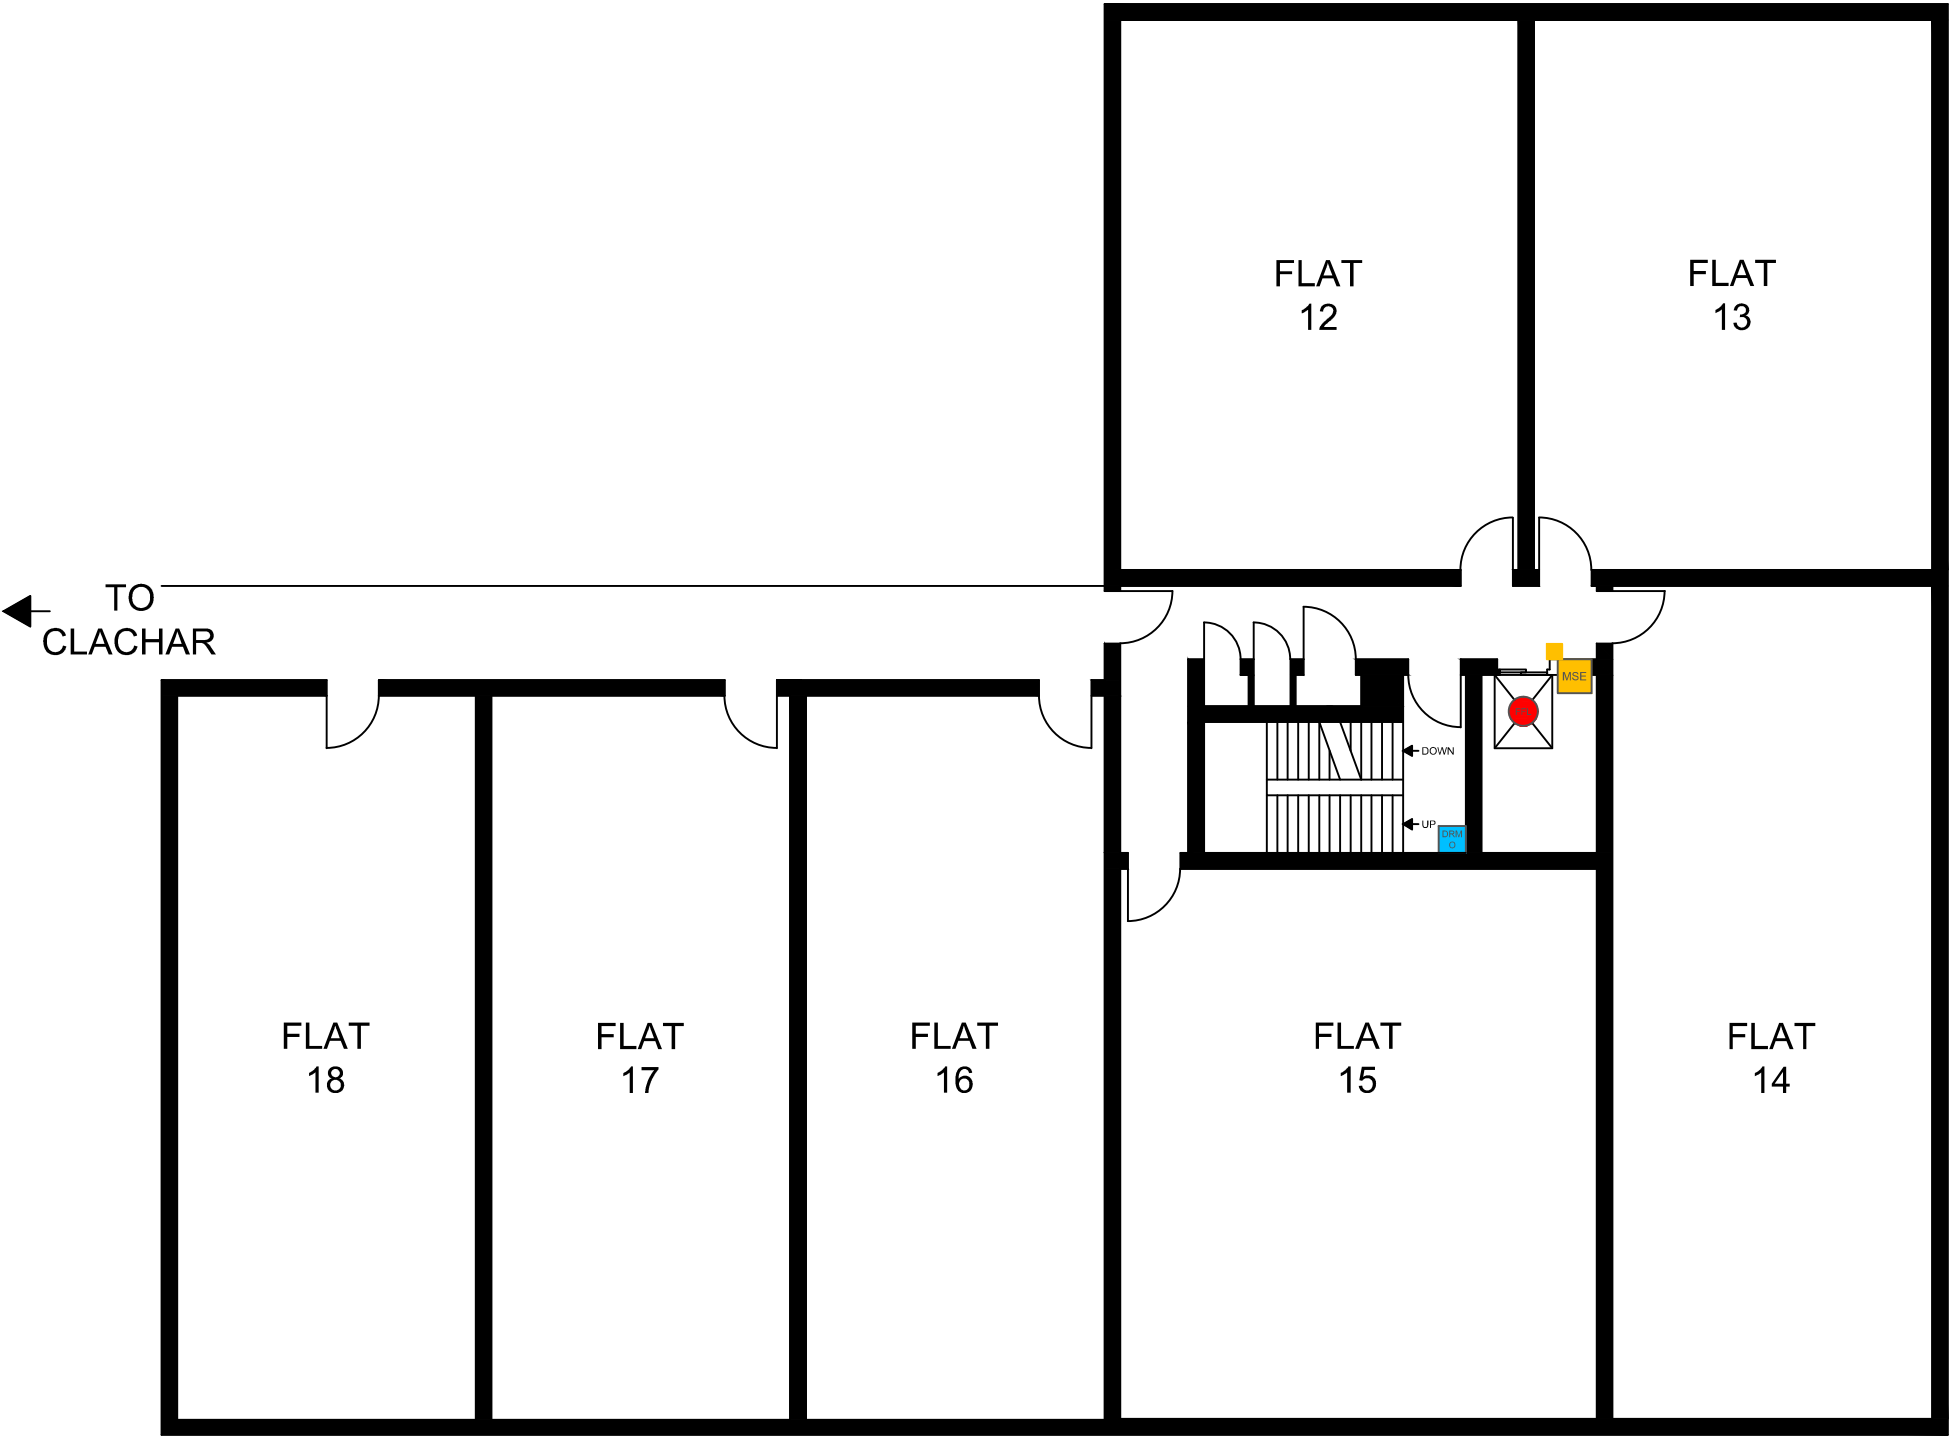

KEY:

MSE

MECHANICAL SMOKE EXTRACTION

FIRE FIGHTING LIFT

DRRO

DRY RISING OUTLET

SMOKE VENT SWITCH

NOTES:
FLAT SEPARATION WALLS ARE APPROXIMATE AND TO BE CONFIRMED

	DRAWING No.	APPROVED BY	DESCRIPTION	JOB NUMBER		DATE
	009		SECOND FLOOR LAYOUT	N/A		17/07/23
	DRAWN BY	CHECKED BY	SITE ADDRESS	SCALE	UNIT	REVISION
	CM	MP	CHAPPELOW COURT, 1-32, BURGESS SPRINGS, CHELMSFORD, CM1 1JL	N.T.S	mm	INFORMATION ONLY