


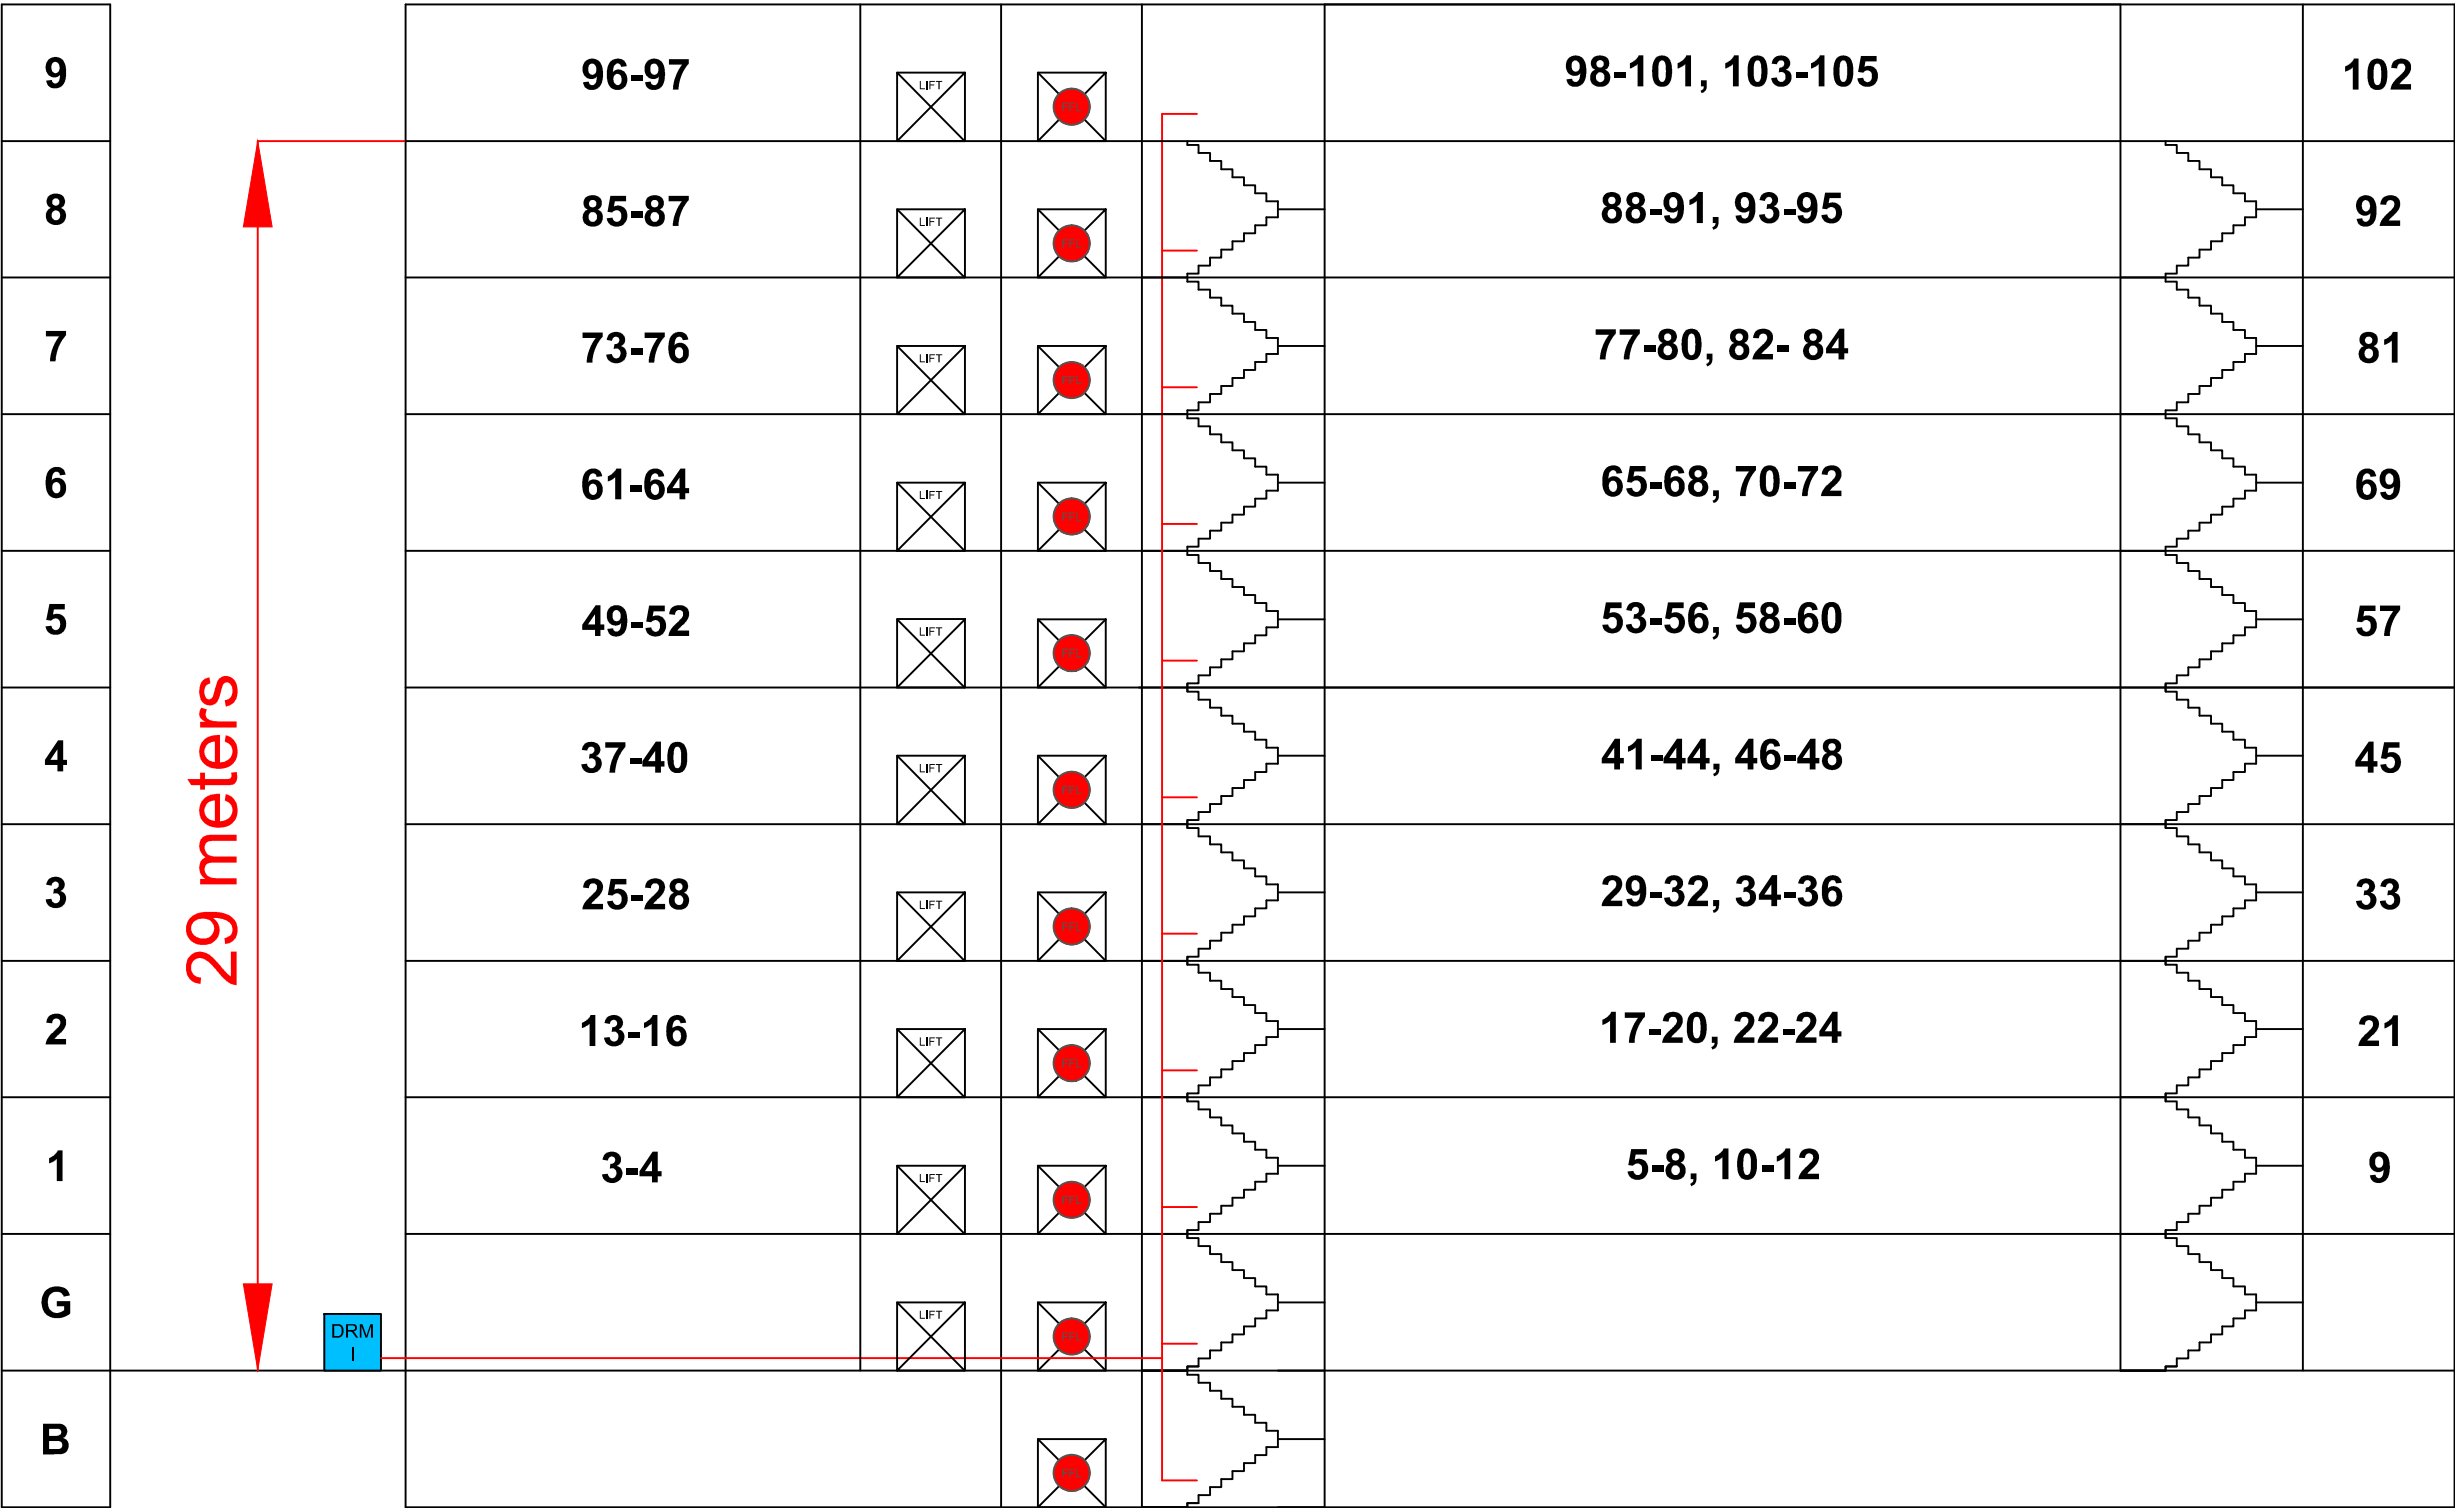

NOTE:

MEASUREMENTS ARE APPROXIMATE

KEY:

PASSENGER LIFT WITH
OVERRIDE SWITCH

DRM
I

DRY RISER INLET

F

DRY RISER SCHEMATIC



DRAWING No.	APPROVED BY	DESCRIPTION
002		
DRAWN BY	CHECKED BY	SITE ADDRESS
N.B	M.P	

VERTICAL SECTION SCHEMATIC

1-105 OPAL COURT, 172 HIGH STREET, E15 2FZ

JOB NUMBER		DATE
N/A		20/8/23
SCALE	UNIT	REVISION
N.T.S	mm	INFORMATION ONLY