


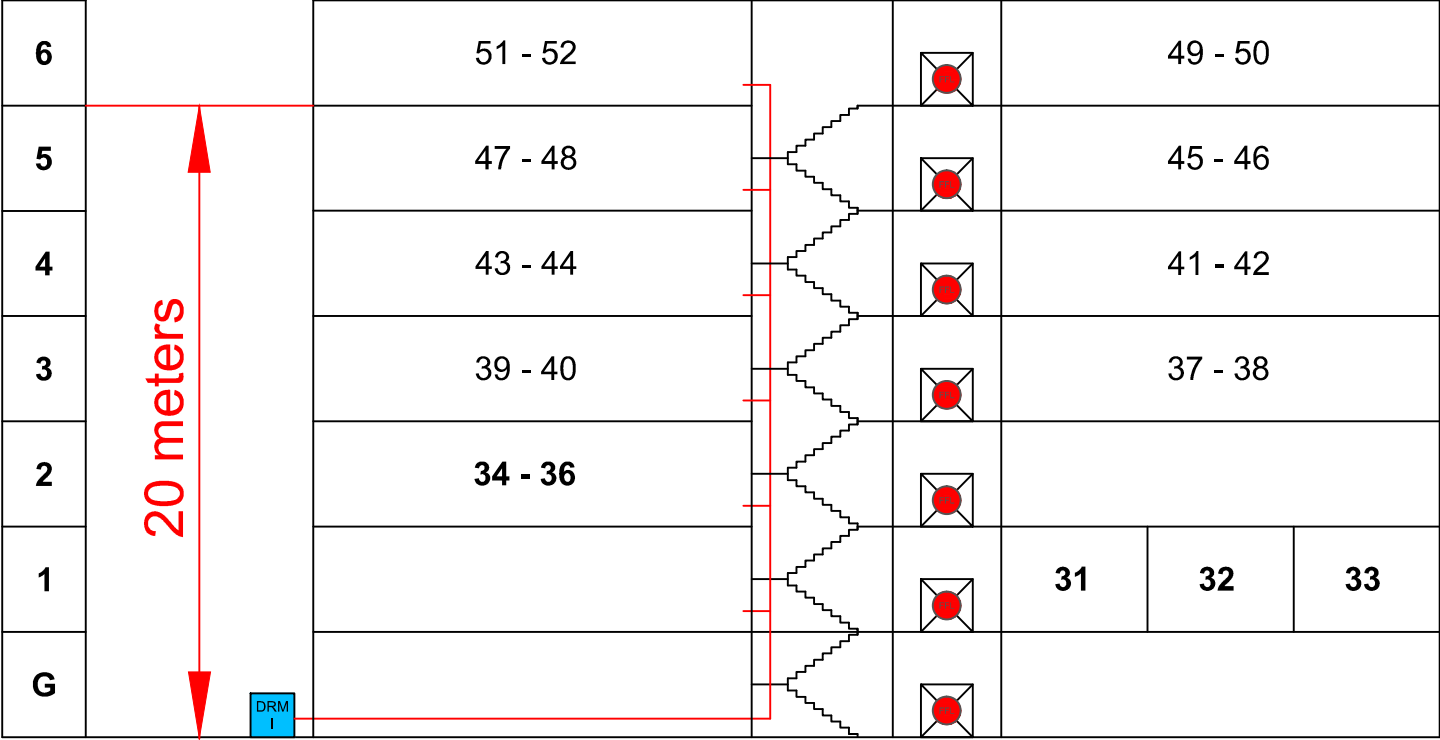

NOTE:

THIS DRAWING IS INTENDED FOR INCLUSION WITHIN THE PIB/ERP ONLY. DUE TO LACK OF SCALING AND INDICATIVE NATURE THIS DRAWING SHOULD NOT BE ISSUED FOR DESIGN OR CONSTRUCTION PURPOSE

MEASUREMENTS ARE APPROXIMATE

KEY:

FIRE FIGHTING LIFT

DRM 1

DRY RISER INLET

F

DRY RISER SCHEMATIC

	DRAWING No.	APPROVED BY	DESCRIPTION				JOB NUMBER		DATE	
	002						N/A		2/2/24	
	DRAWN BY	CHECKED BY	SITE ADDRESS				SCALE	UNIT	REVISION	
	N.B.L	MP					N.T.S		mm	
			VERTICAL SECTION SCHEMATIC							
			BOYD BUILDING, 10 FROBISHER YARD, E16 2GY							