




NOTE:
MEASUREMENTS ARE APPROXIMATE

KEY:
 FIREFIGHTING LIFT
 DRY RISER INLET
 DRY RISER SCHEMATIC

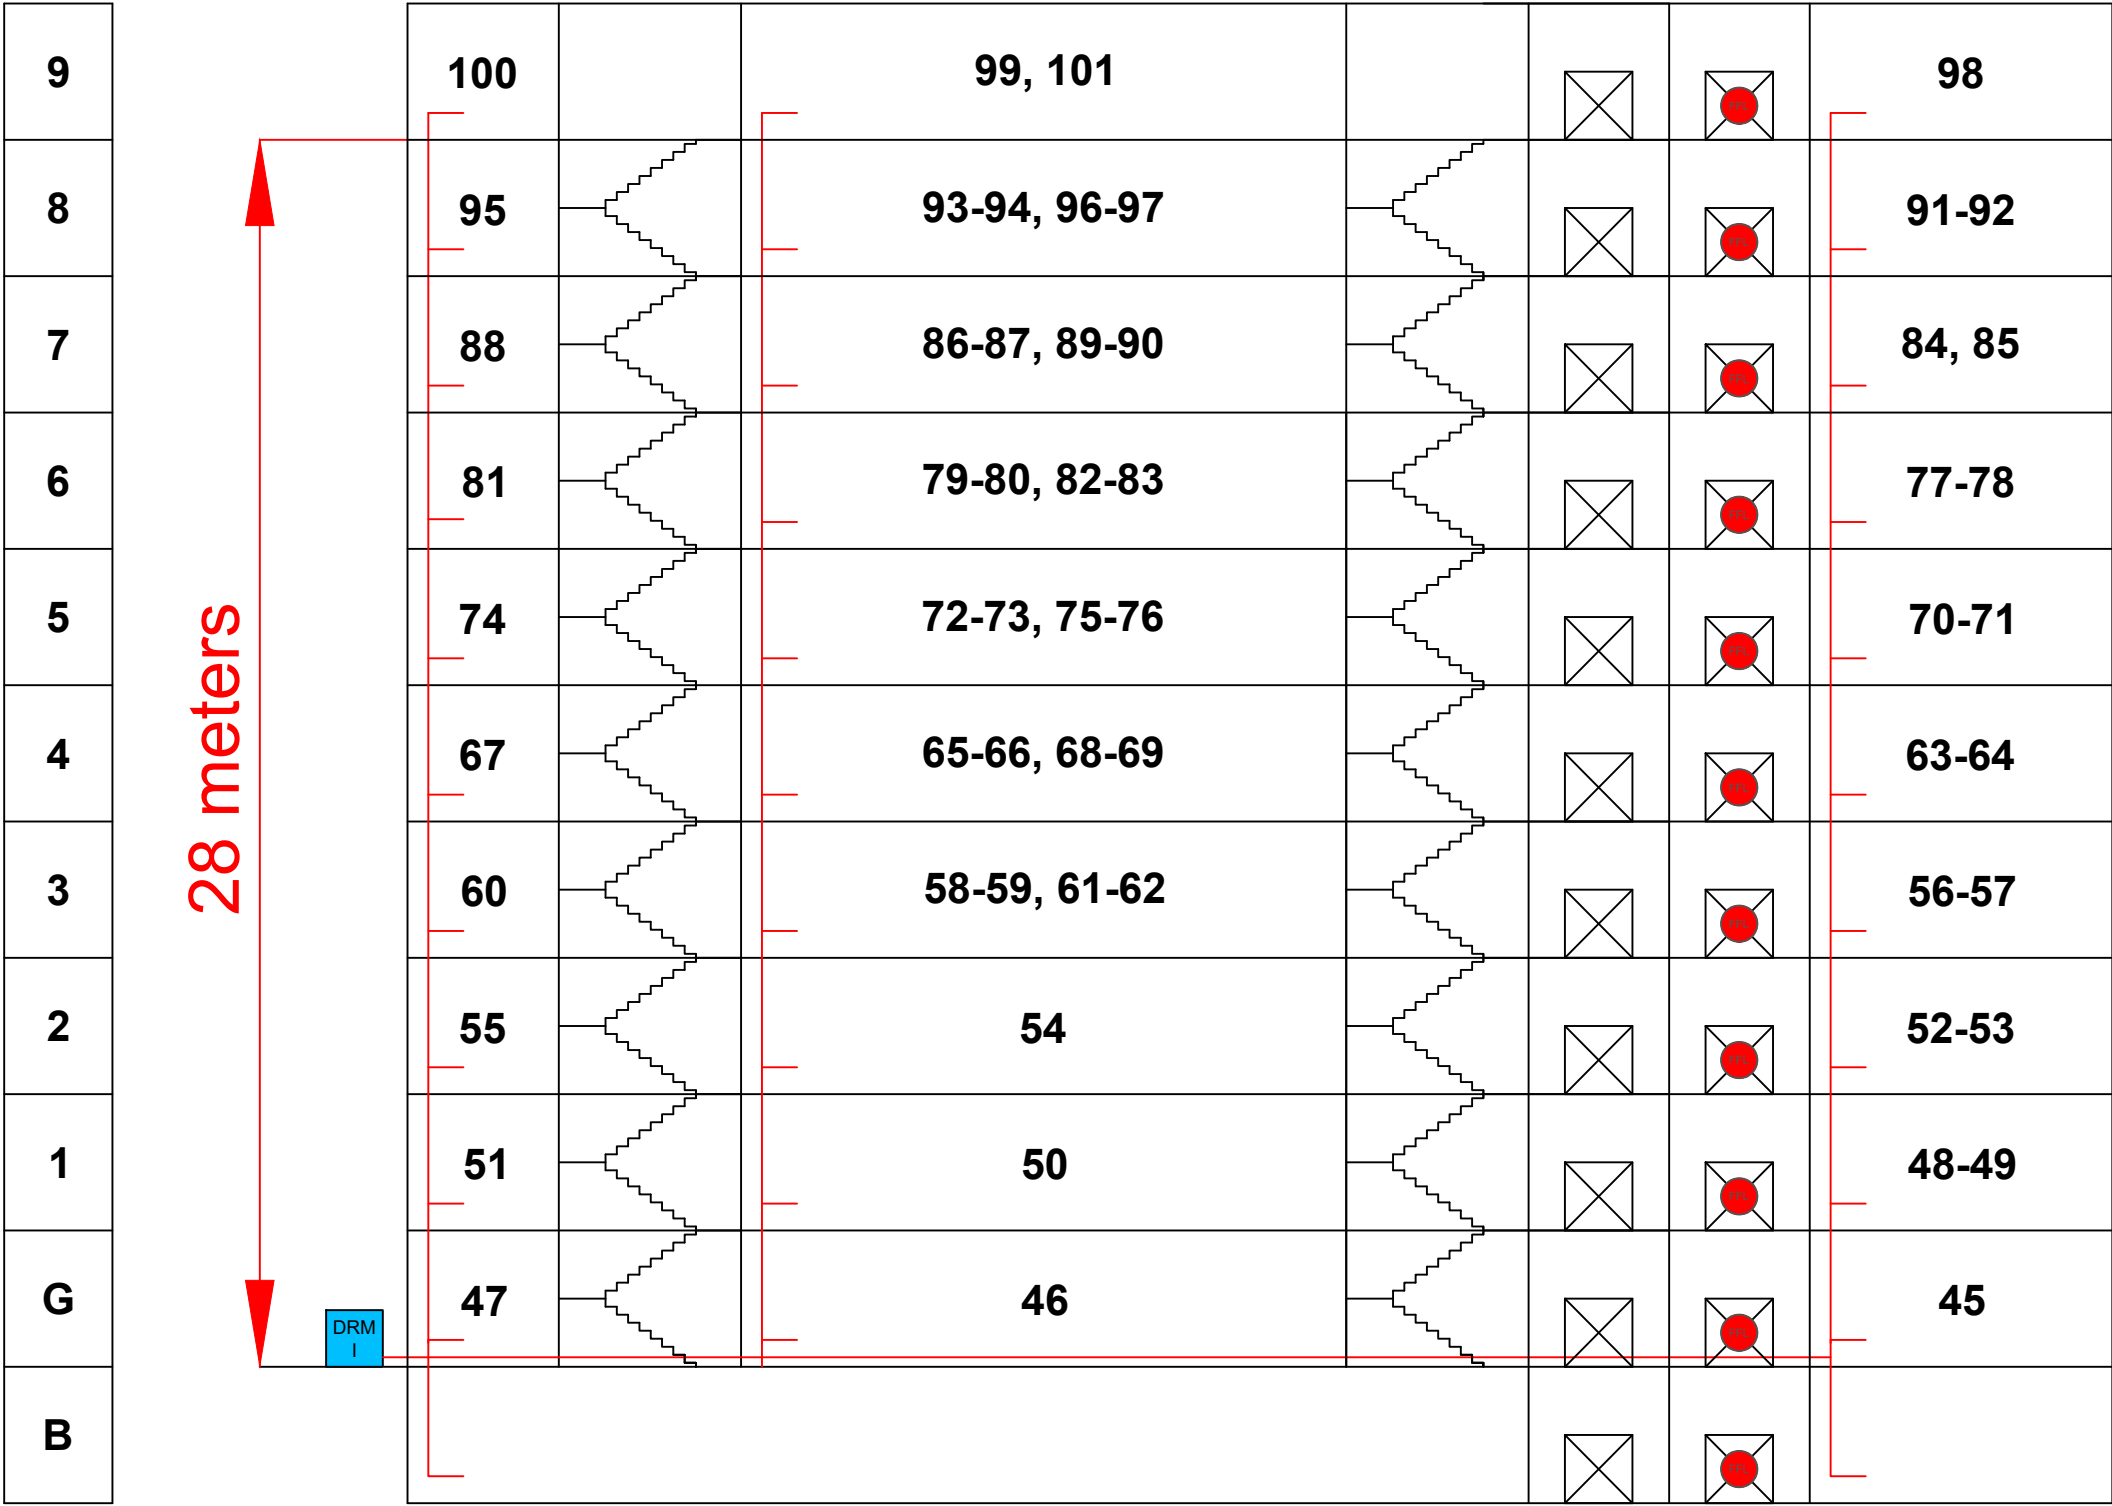

DRAWING No.	APPROVED BY	DESCRIPTION	JOB NUMBER		DATE
002			N/A		13/8/23
DRAWN BY	CHECKED BY	SITE ADDRESS	SCALE	UNIT	REVISION
N.B	M.P	45-101 DONNINGTON COURT, DONNINGTON ROAD, NW10 3TJ	N.T.S	mm	INFORMATION ONLY