


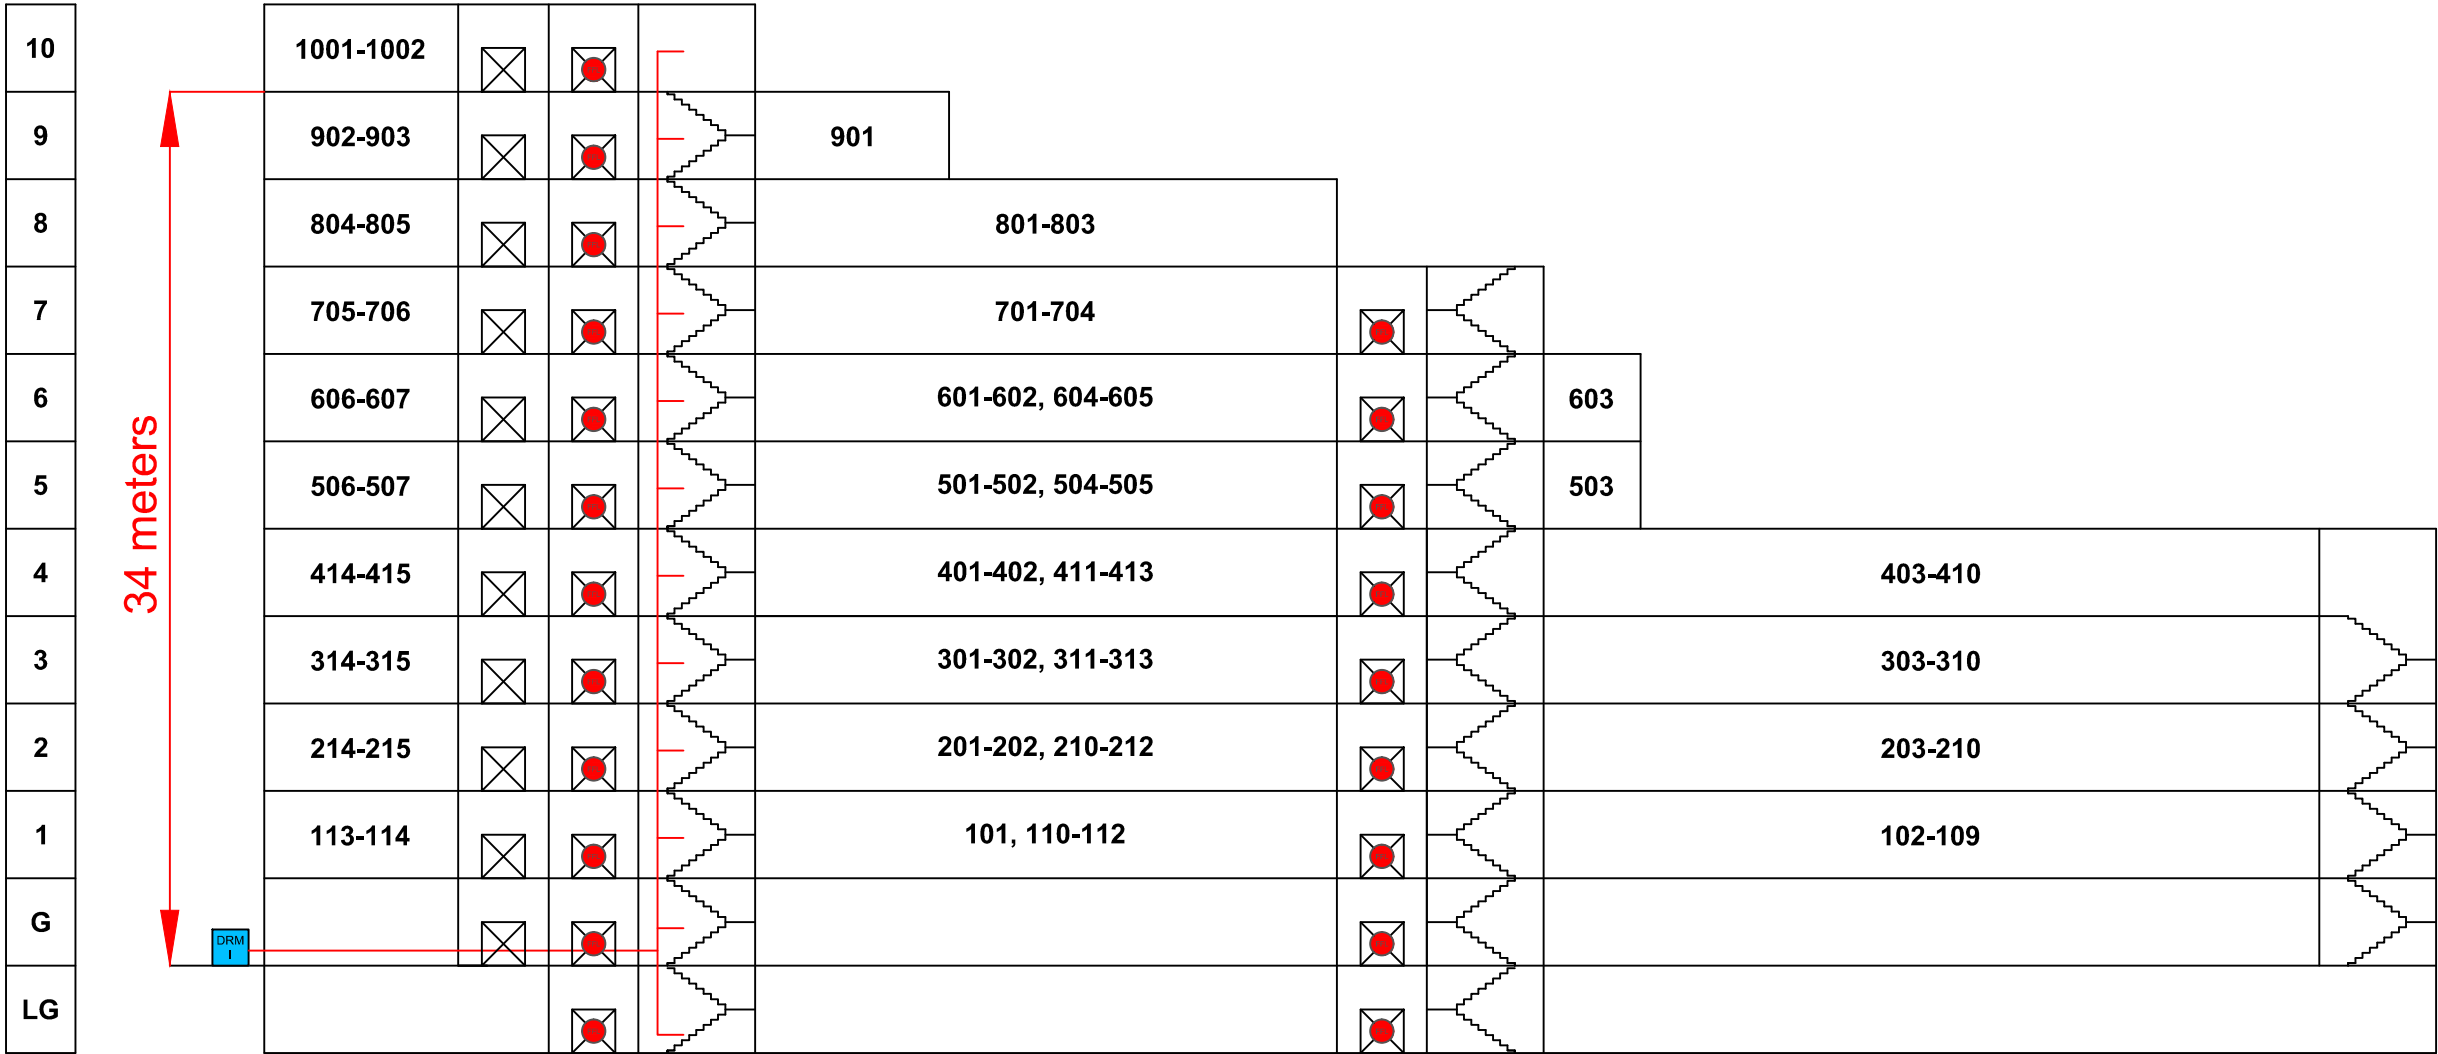

NOTE:

MEASUREMENTS ARE APPROXIMATE

KEY:

FIRE FIGHTING LIFT

DRY RISER INLET

DRY RISER SCHEMATIC



DRAWING No.	APPROVED BY	DESCRIPTION
002		VERTICAL SECTION SCHEMATIC
DRAWN BY	CHECKED BY	SITE ADDRESS
N.B	M.P	101-415 & 501-1002 Avalon Court, Great Whip Street, 1P2 8EY

JOB NUMBER		DATE
N/A		21/8/23
SCALE	UNIT	REVISION
N.T.S	mm	INFORMATION ONLY