


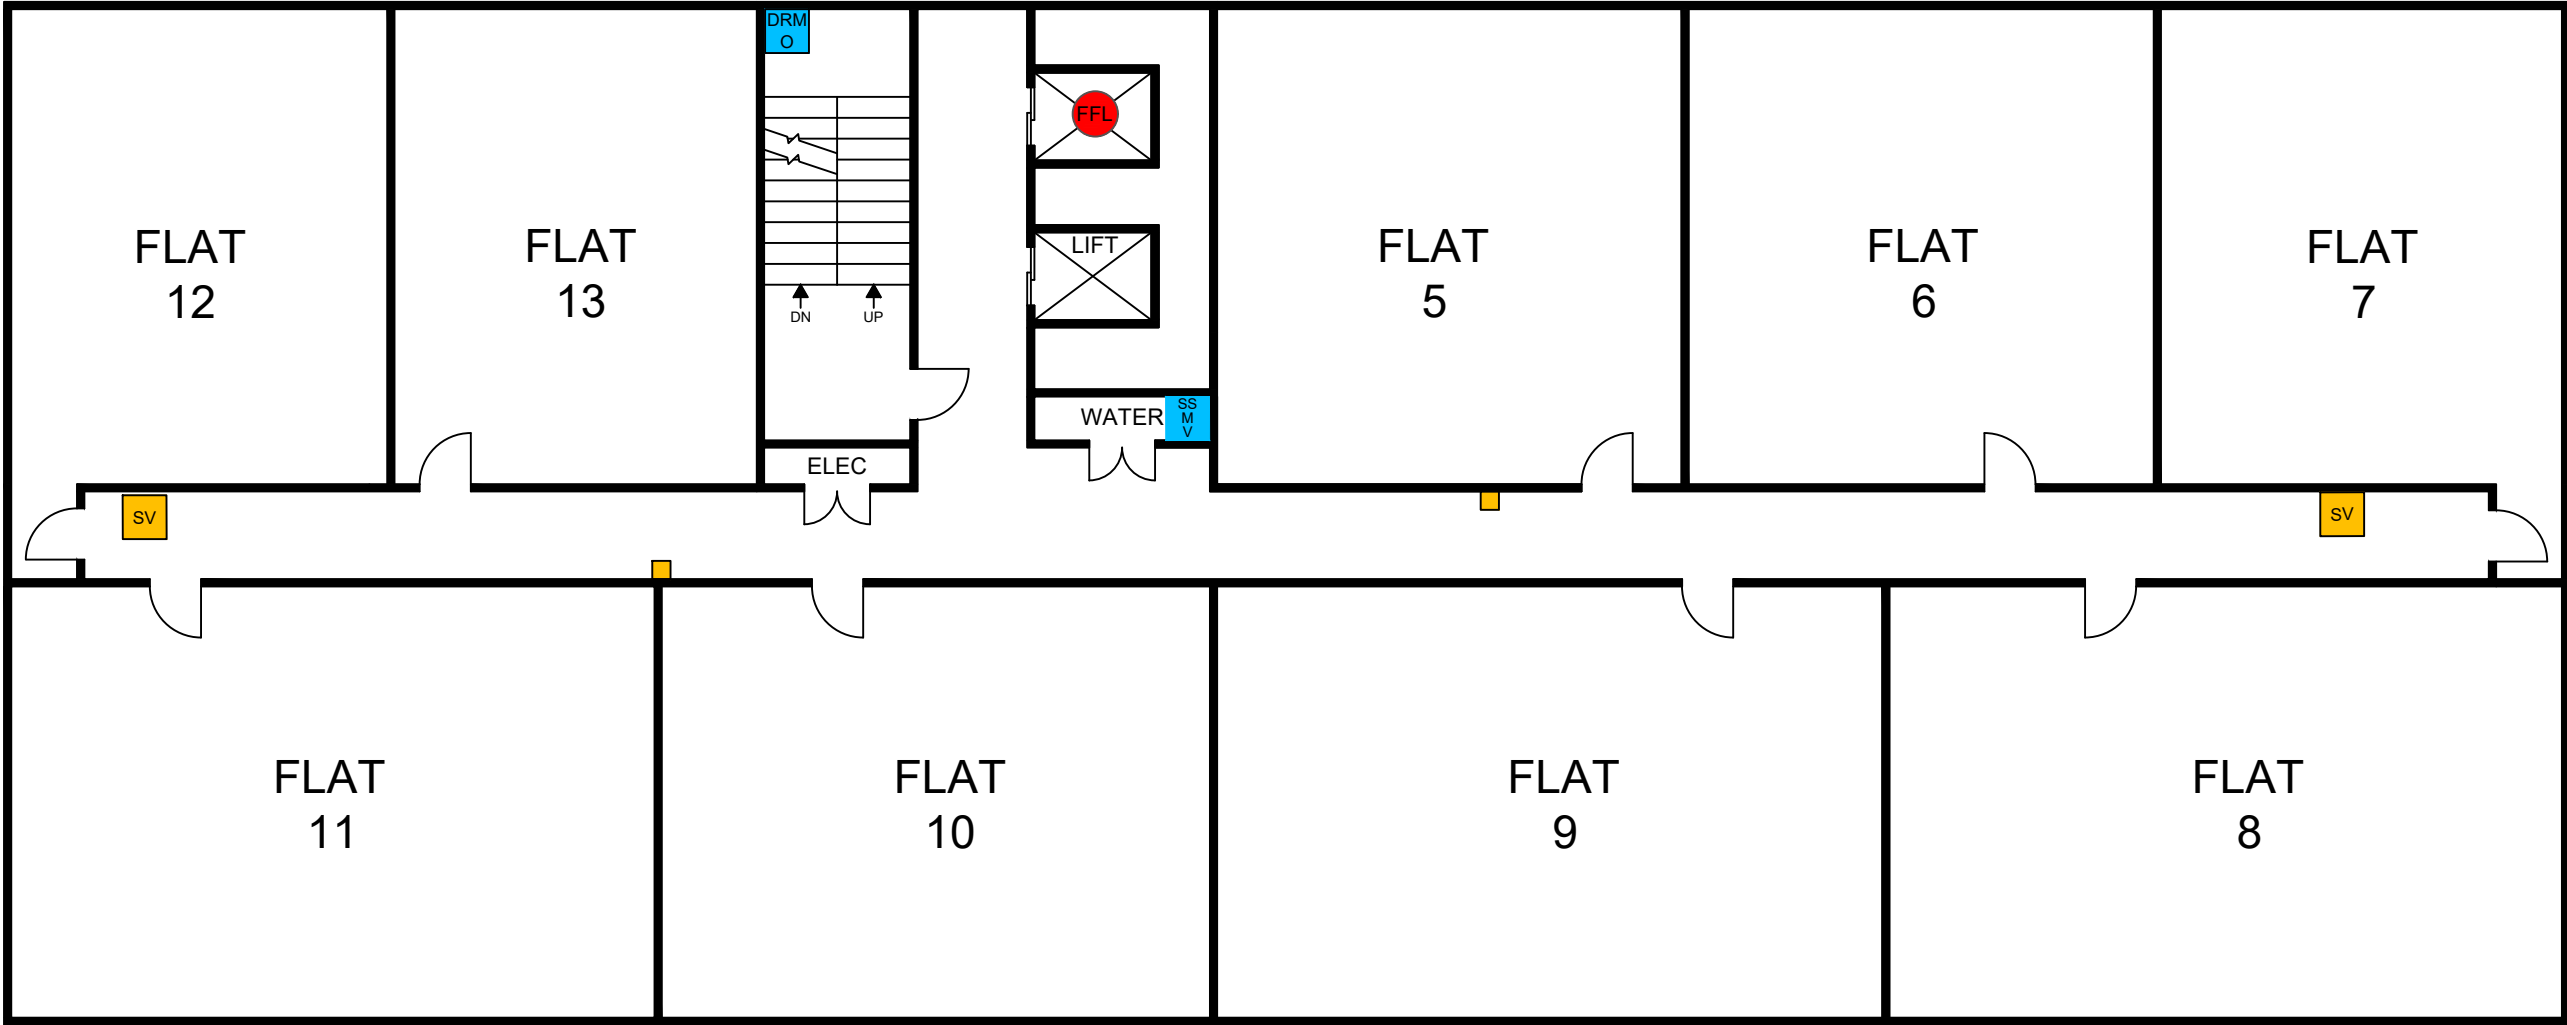

NOTES:

FLAT SEPARATION WALLS ARE APPROXIMATE AND TO BE CONFIRMED

THIS DRAWING IS INTENDED FOR INCLUSION WITHIN THE PIB/ERP ONLY. DUE TO LACK OF SCALING AND INDICATIVE NATURE THIS DRAWING SHOULD NOT BE ISSUED FOR DESIGN OR CONSTRUCTION PURPOSE

KEY:

-  SPRINKLER STOP VALVE
-  FIREFIGHTING LIFT
-  SMOKE VENT
-  SMOKE VENT SWITCH
-  DRY RISER OUTLET

	DRAWING No.	APPROVED BY	DESCRIPTION				JOB NUMBER		DATE	
	008						N/A		14/10/24	
	DRAWN BY	CHECKED BY	SITE ADDRESS				SCALE	UNIT	REVISION	
	N.B.L	MP					N.T.S	mm	INFORMATION ONLY	
			SECOND FLOOR LAYOUT							
			Reade Court, 44 Clovelly Road, Hounslow TW3 4FH							