


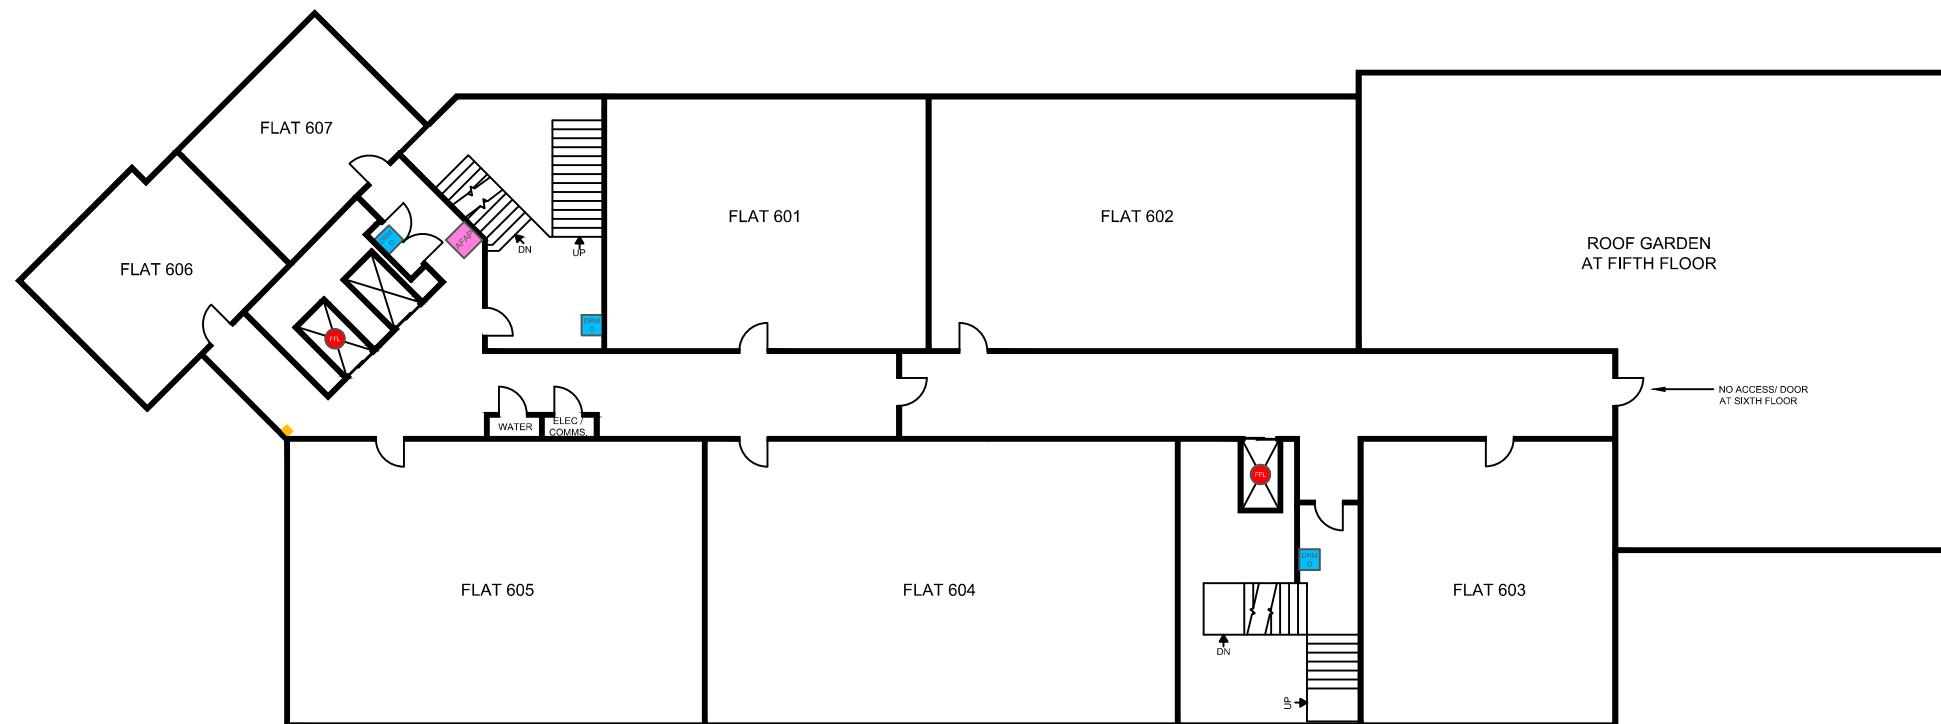

KEY:	
	FIRE FIGHTING LIFT
	MECHANICAL SMOKE EXTRACTION
	SMOKE VENT SWITCH
	FIRE ALARM PANEL
	DRY RISING FIRE MAIN

KEY:	
FLAT SEPARATION WALLS ARE APPROXIMATE AND TO BE CONFIRMED	

	DRAWING No.	APPROVED BY	DESCRIPTION				JOB NUMBER		DATE			
	014						N/A		07/08/23			
	DRAWN BY	CHECKED BY	SITE ADDRESS				SCALE	UNIT	REVISION			
	AN	MP					N.T.S		mm		INFORMATION ONLY	
							101-415 & 501-1002 Avalon Court, Great Whip Street, 1P2 8EY					