


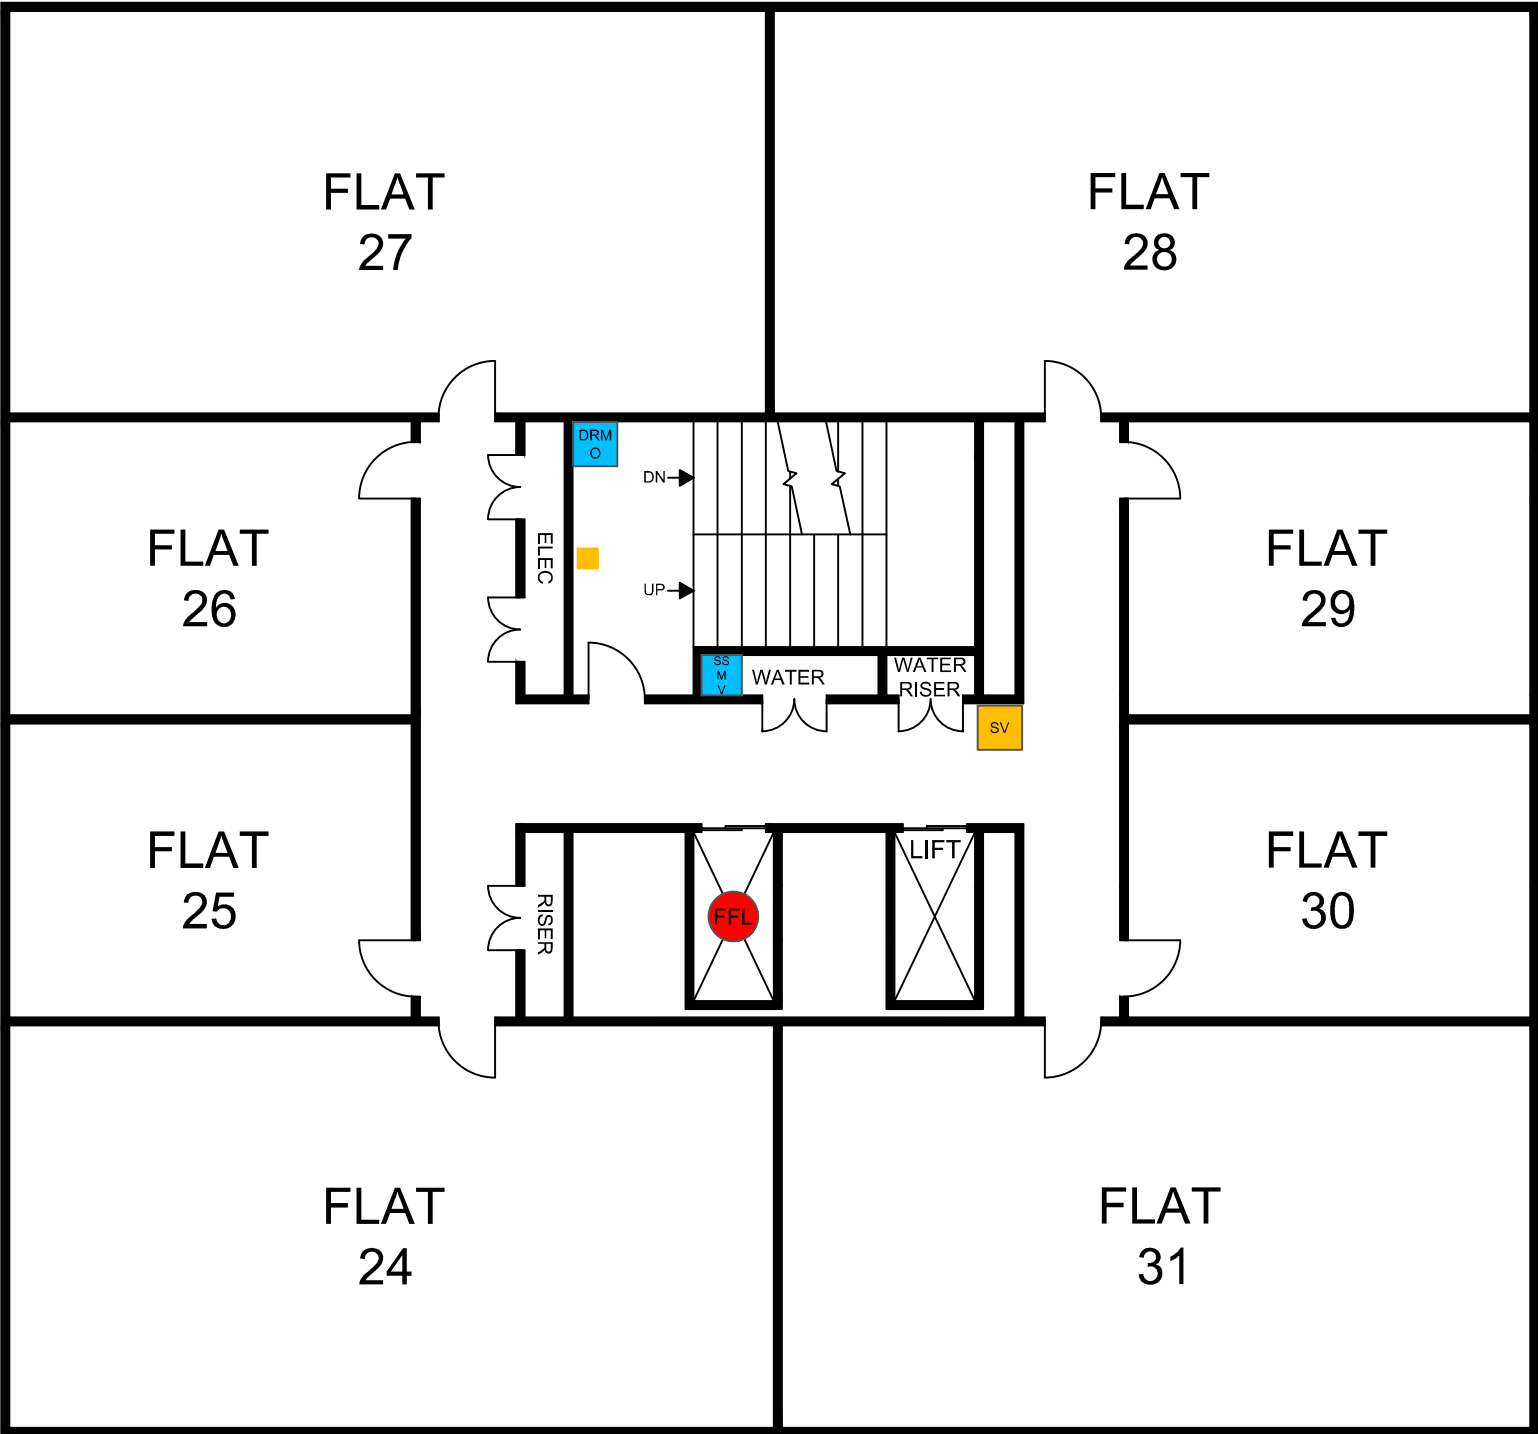

NOTES:

FLAT SEPARATION WALLS ARE APPROXIMATE AND TO BE CONFIRMED

THIS DRAWING IS INTENDED FOR INCLUSION WITHIN THE PIB/ERP ONLY. DUE TO LACK OF SCALING AND INDICATIVE NATURE THIS DRAWING SHOULD NOT BE ISSUED FOR DESIGN OR CONSTRUCTION PURPOSE

KEY:

DRM O

DRY RISER OUTLET

SV

SMOKE VENT

SMOKE VENT SWITCH

FFL

FIRE-FIGHTING LIFT

SSM V

SPRINKLER SYSTEM VALVE

	DRAWING No.	APPROVED BY	DESCRIPTION				JOB NUMBER		DATE
	010		FIFTH FLOOR LAYOUT				N/A		14/03/24
	DRAWN BY	CHECKED BY	SITE ADDRESS				SCALE	UNIT	REVISION
	N.B.L	MP	GUTHRUM COURT 1 CAVENDISH SQUARE, LONDON, E16 2XN				N.T.S	mm	INFORMATION ONLY