


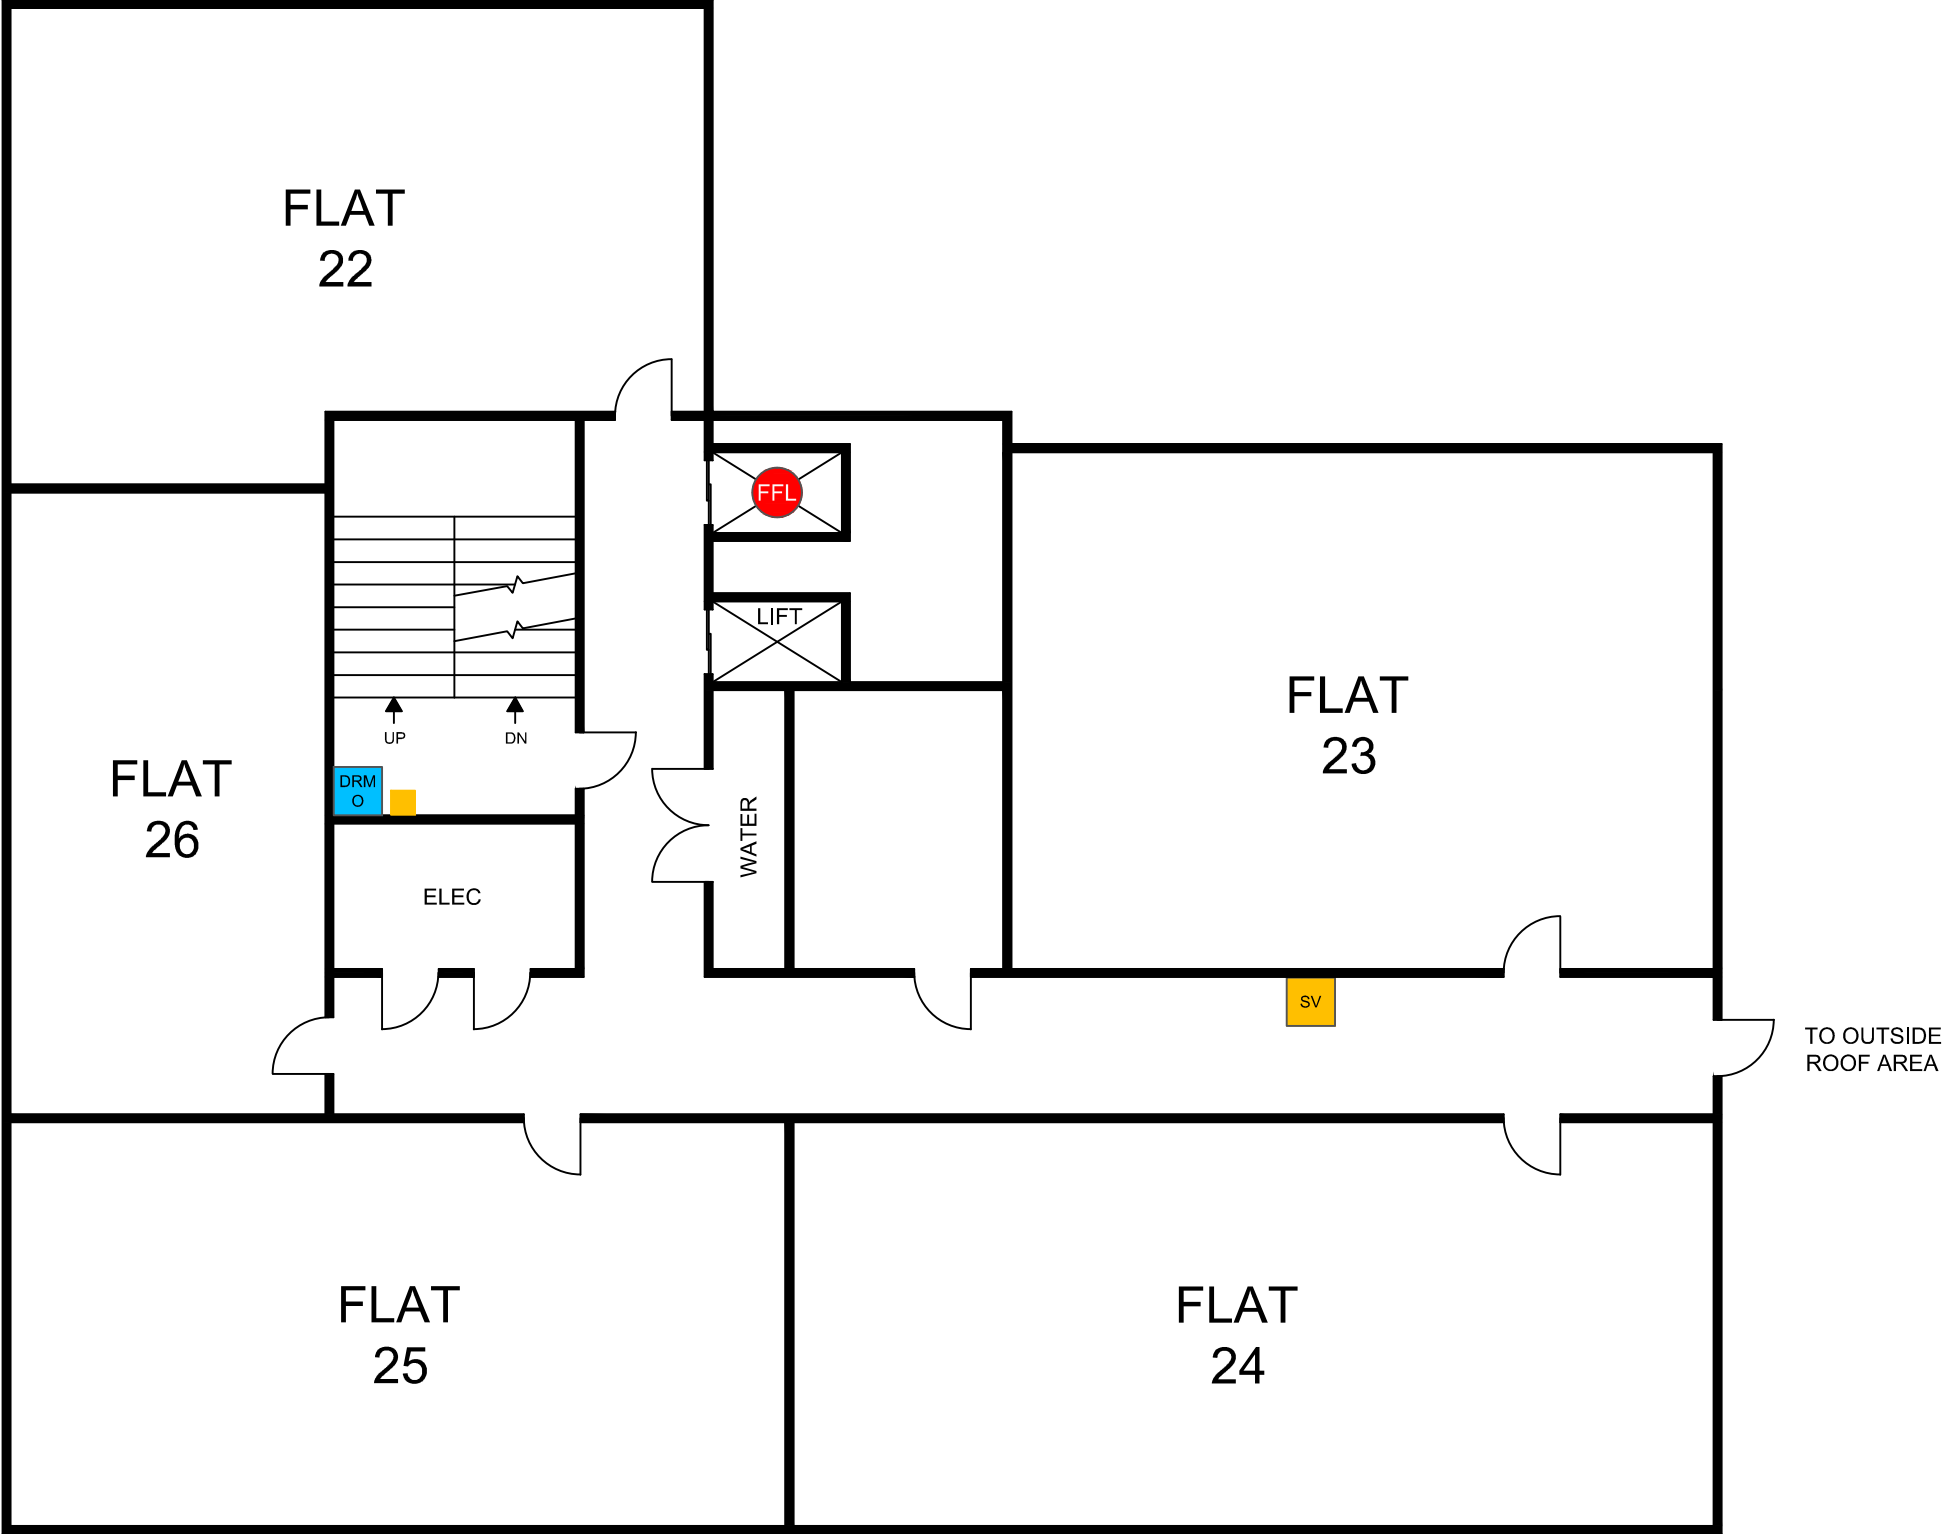

NOTES:

FLAT SEPARATION WALLS ARE APPROXIMATE AND TO BE CONFIRMED

THIS DRAWING IS INTENDED FOR INCLUSION WITHIN THE PIB/ERP ONLY. DUE TO LACK OF SCALING AND INDICATIVE NATURE THIS DRAWING SHOULD NOT BE ISSUED FOR DESIGN OR CONSTRUCTION PURPOSE

KEY:

■

 SMOKE VENT SWITCH

● FFL

 FIRE FIGHTING LIFT

■ SV

 SMOKE VENT

■ DRM O

 DRY RISER OUTLET

	DRAWING No.	APPROVED BY	DESCRIPTION				JOB NUMBER		DATE
	009		FOURTH FLOOR LAYOUT				N/A		19/02/24
	DRAWN BY	CHECKED BY	SITE ADDRESS				SCALE	UNIT	REVISION
	N.B.L	MP	Althorp Court, 26-41 Clovelly Road, Hounslow, TW3 4FF				N.T.S	mm	INFORMATION ONLY