


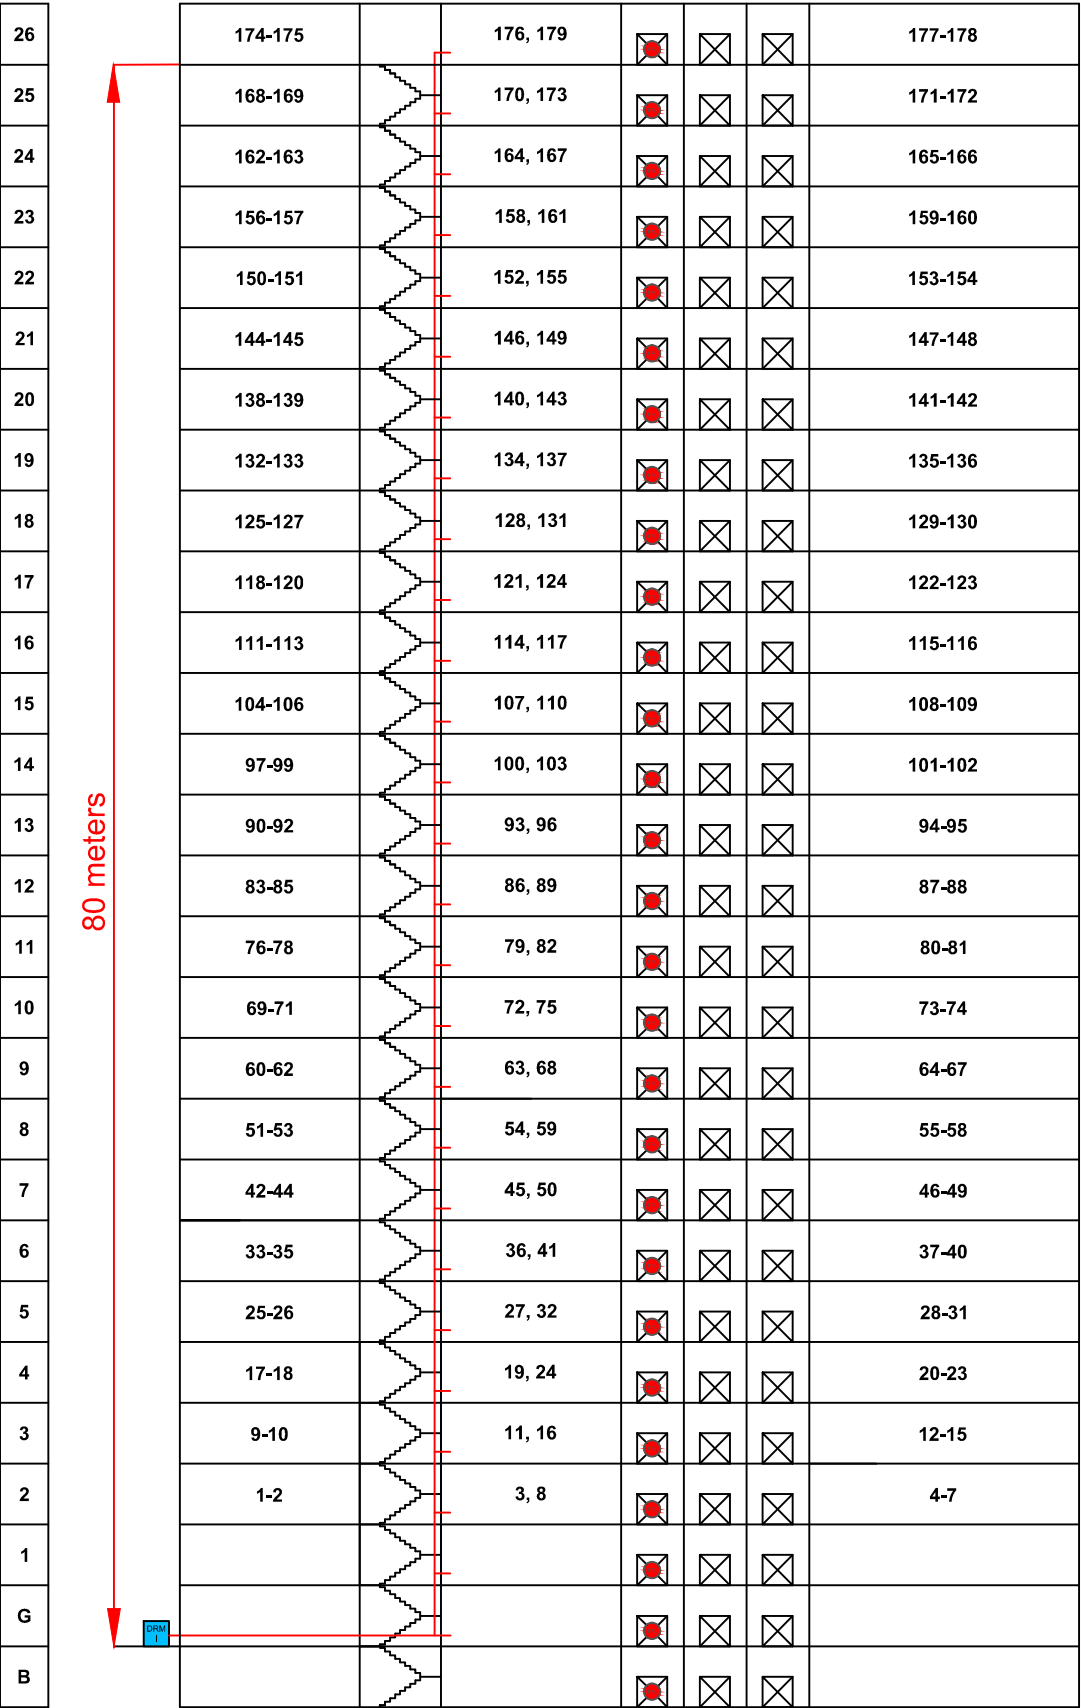

NOTE:

MEASUREMENTS ARE APPROXIMATE

KEY:

FIRE FIGHTING LIFT

DRM

1

DRY RISER INLET

DRY RISER SCHEMATIC

	DRAWING No.	APPROVED BY	DESCRIPTION			JOB NUMBER		DATE
	002					N/A		14/9/23
	DRAWN BY	CHECKED BY	SITE ADDRESS			SCALE	UNIT	REVISION
	AB	M.P				1 - 179 WALDEGRAVE POINT, 1 GREEN STREET, NW10 6FN		