


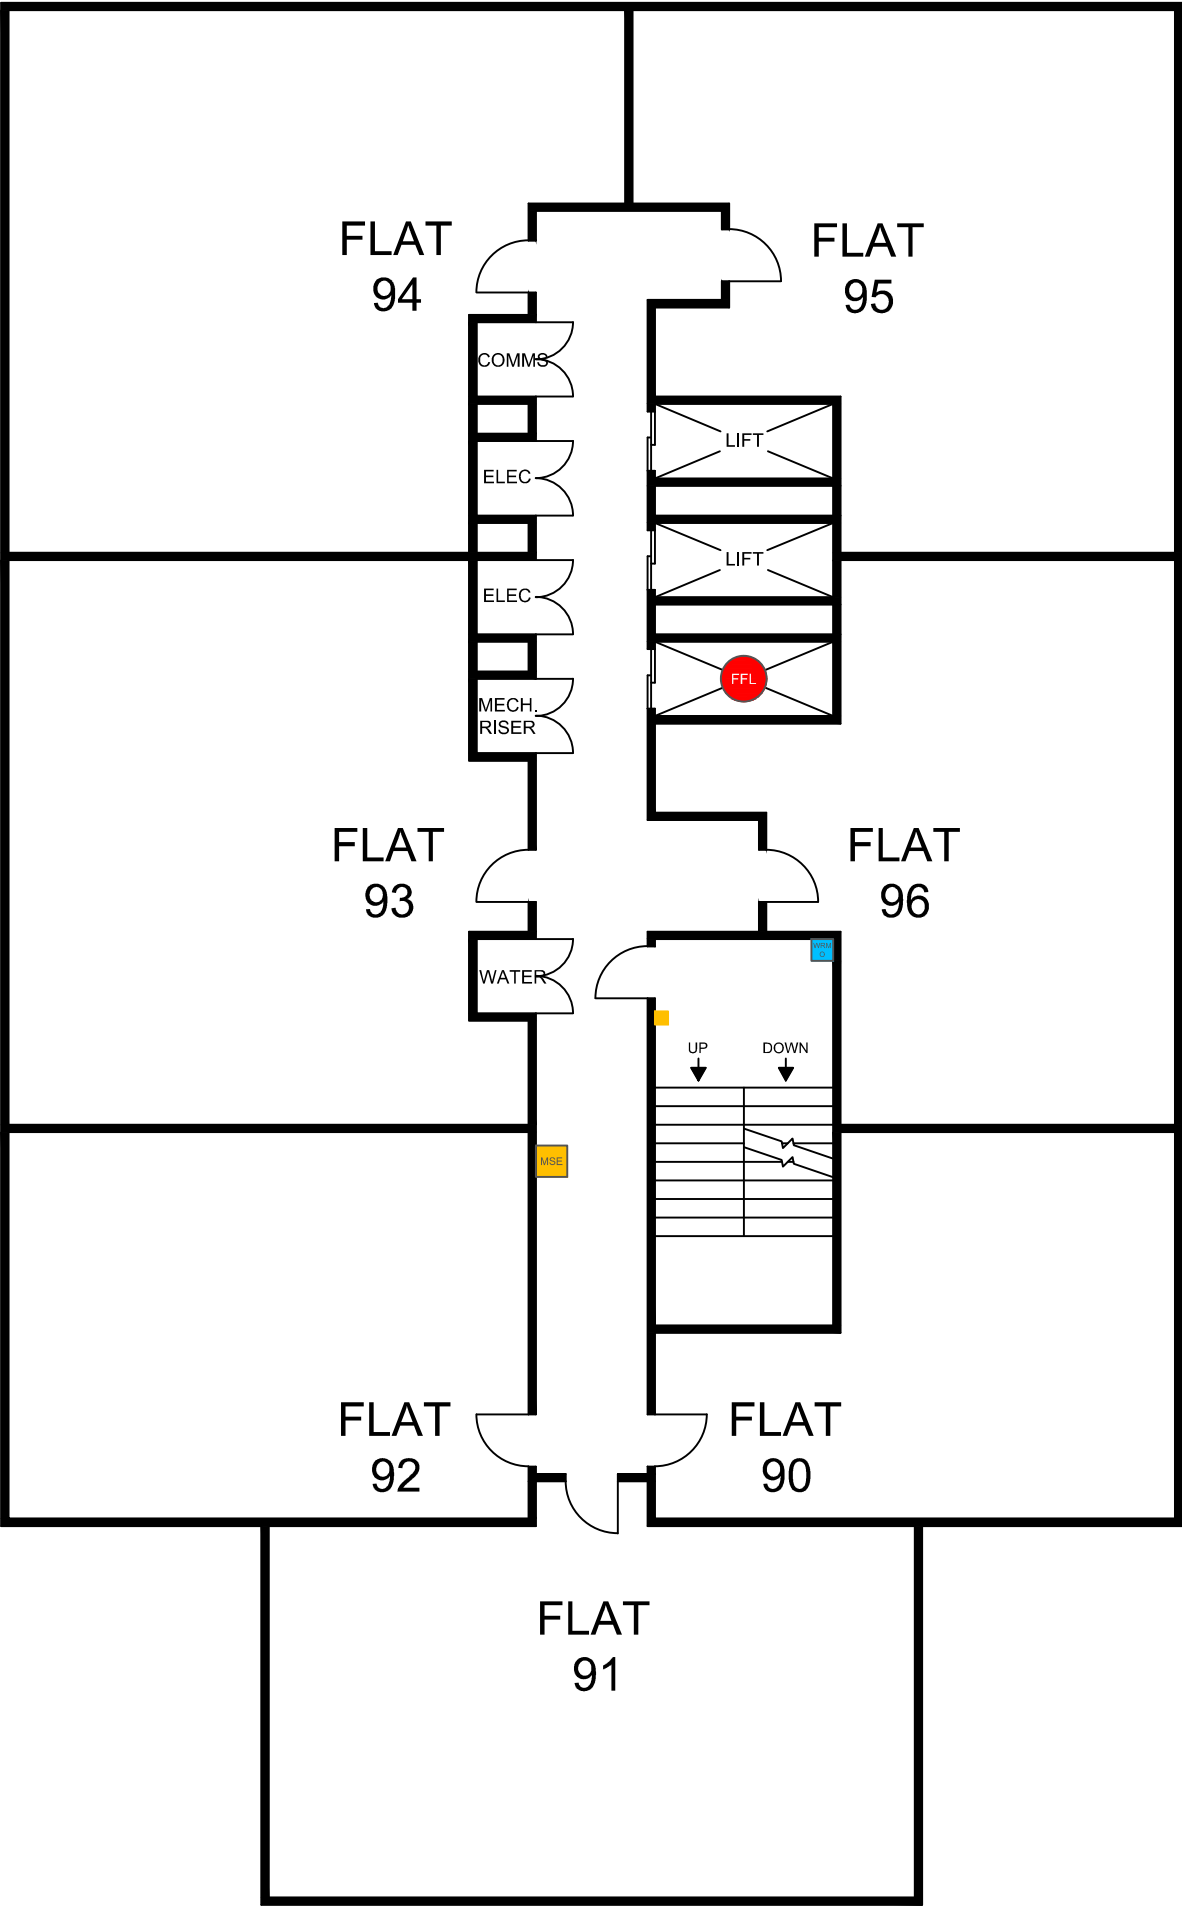

KEY:
FLAT SEPARATION WALLS ARE APPROXIMATE AND TO BE CONFIRMED

- KEY:
- WET RISER OUTLET
 - FIREFIGHTING LIFT
 - MECHANICAL SMOKE EXTRACTION
 - SMOKE VENT SWITCH

	DRAWING No.	APPROVED BY	DESCRIPTION	JOB NUMBER		DATE	
	020			N/A		19/07/23	
	DRAWN BY	CHECKED BY	SITE ADDRESS	SCALE	UNIT	REVISION	
	AB	MP	1 - 179 WALDEGRAVE POINT, 1 GREEN STREET, NW10 6FN	N.T.S	mm	INFORMATION ONLY	