


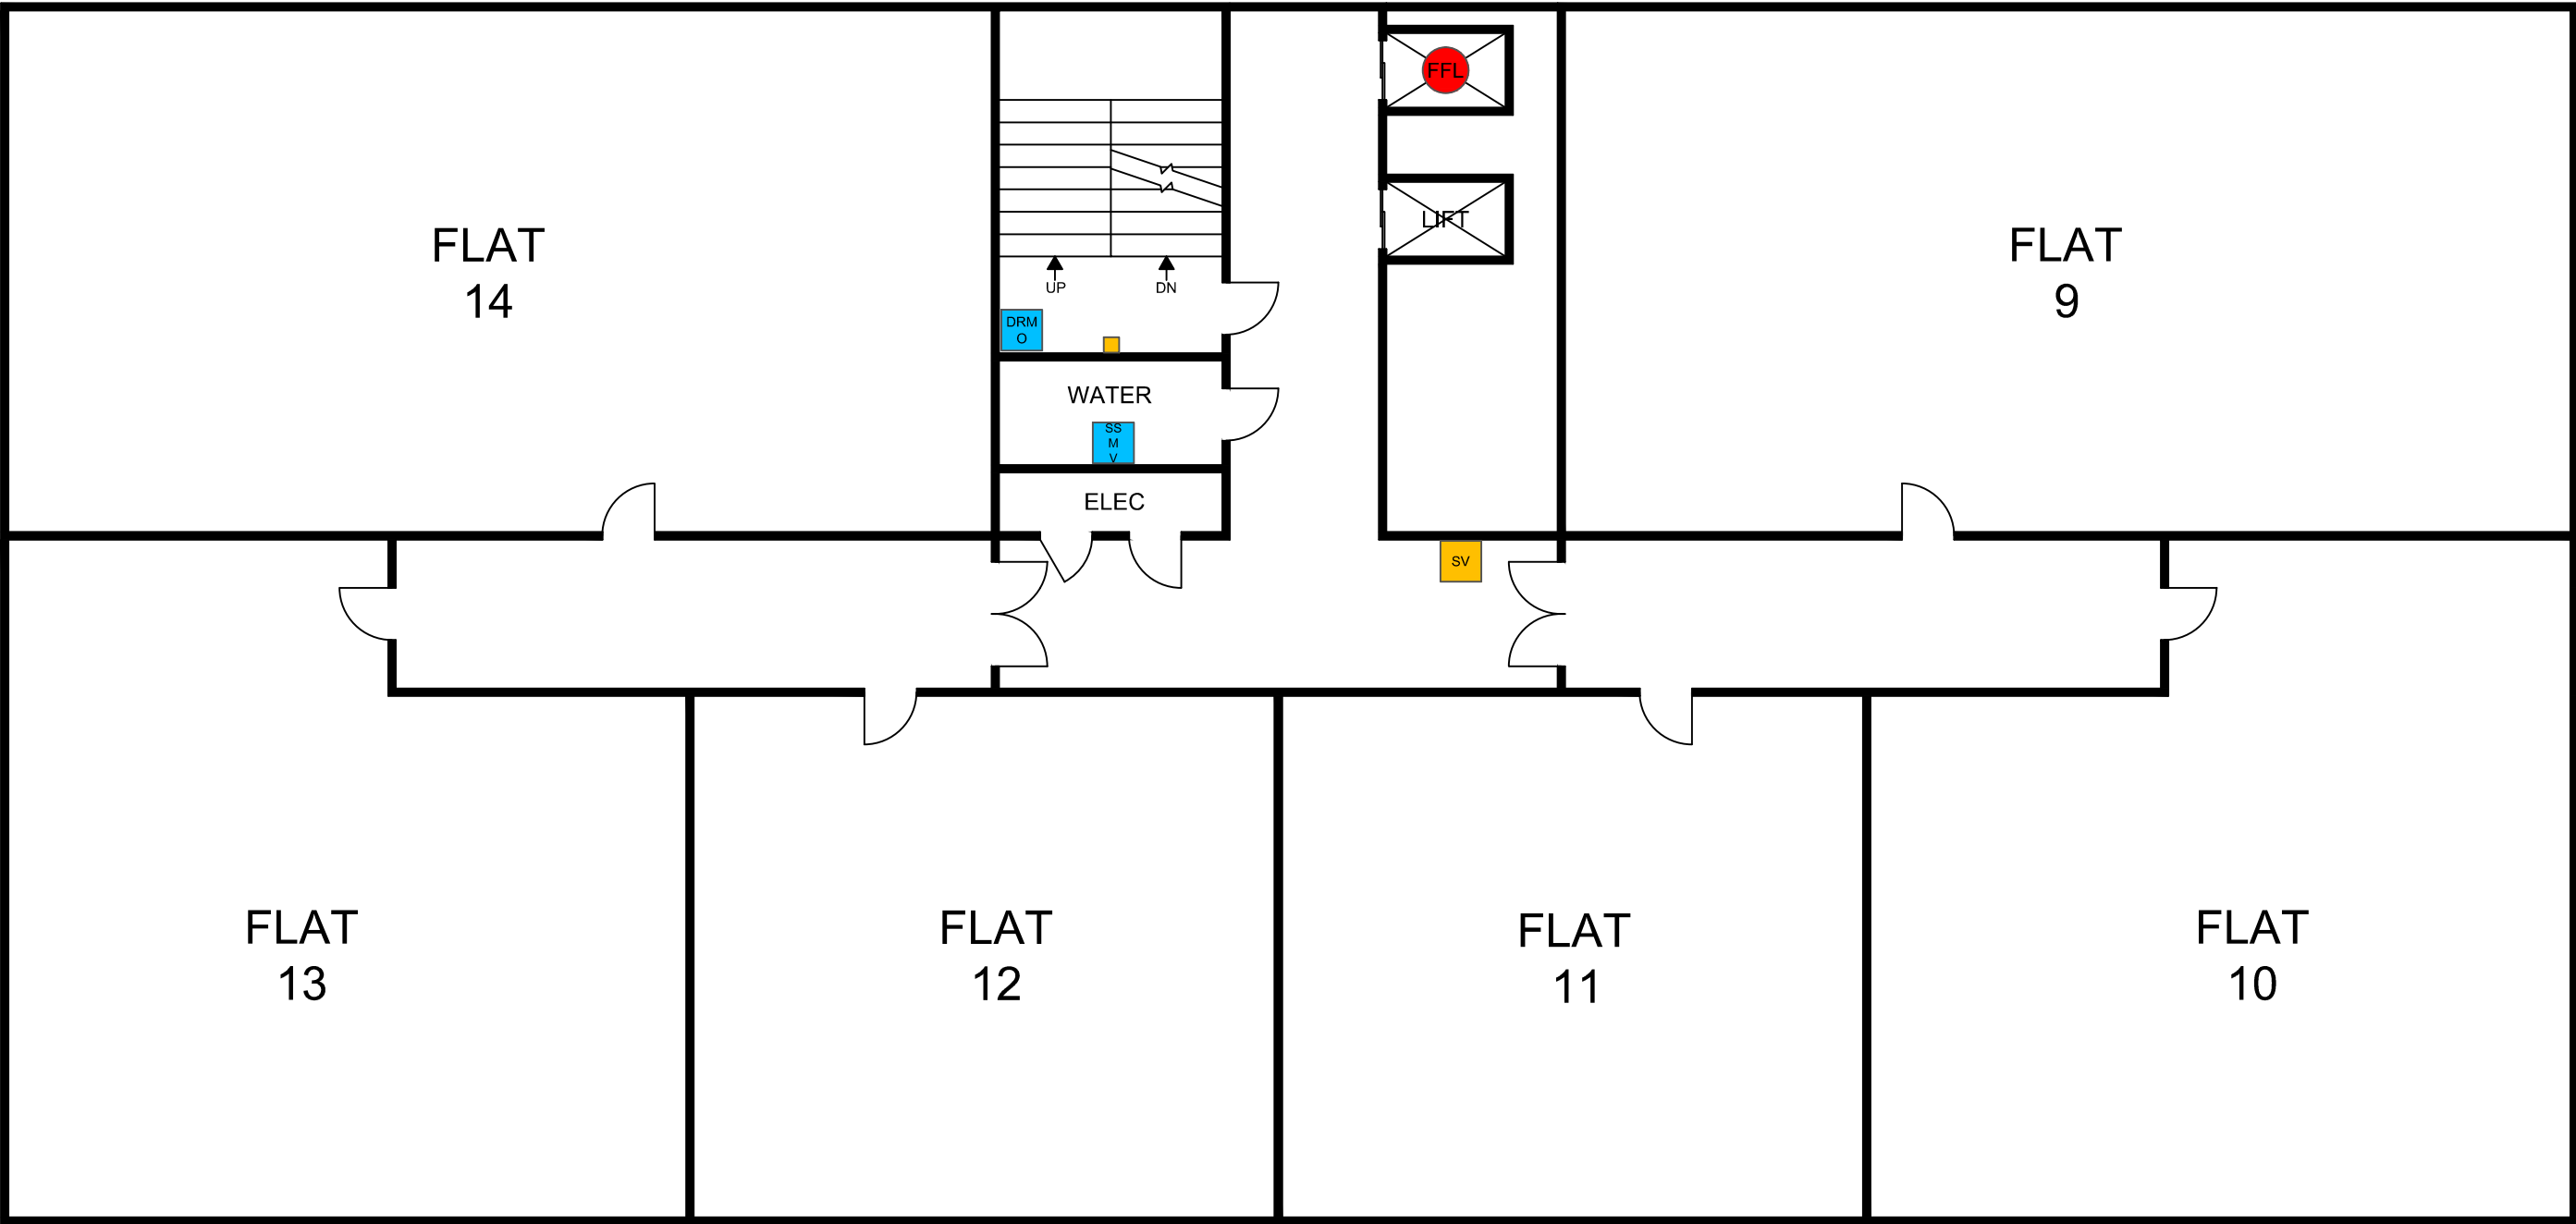

KEY:

DRM
O

SV

FFL

SS
M
V

DRY RISER OUTLET

SMOKE VENT

FIRE-FIGHTING LIFT

SMOKE VENT SWITCH

SPRINKLER
SYSTEM VALVE

NOTES:

FLAT SEPARATION WALLS ARE APPROXIMATE AND TO BE CONFIRMED

THIS DRAWING IS INTENDED FOR INCLUSION WITHIN THE PIB/ERP ONLY. DUE TO LACK OF SCALING AND INDICATIVE NATURE THIS DRAWING SHOULD NOT BE ISSUED FOR DESIGN OR CONSTRUCTION PURPOSE

	DRAWING No.	APPROVED BY	DESCRIPTION				JOB NUMBER		DATE
	009		THIRD FLOOR LAYOUT				N/A		13/03/24
	DRAWN BY	CHECKED BY	SITE ADDRESS				SCALE	UNIT	REVISION
	N.B.L	MP	Lyle Apartments, 15-23 Shackleton Way, London, E16 2XS				N.T.S	mm	INFORMATION ONLY